

This project is a remodel of an existing secure psychiatric wing for adults within the CHI St. Alexius hospital in Williston North Dakota. The existing interior construction of the wing will be demolished for an updated interior layout of approximately 6600 square feet. The scope will not add to the hospital footprint or Gross Building Area.

The scope of work includes the remodel of an adjacent outpatient mental health clinic. The construction at this portion of the work involves adjustments to the hospital corridor; the work will be phased to maintain egress through this portion of the hospital.

APPLICABLE CODES

- Building Code 2024 International Building Code (IBC), as amended by the North Dakota State Building Code
State Amendments North Dakota State Building Code 2023 (NDCC Chapter 54-21.3)
City Amendments None
Fire Code 2024 International Fire Code (IFC)
Mechanical Code 2024 International Mechanical Code (IMC), as amended by the North Dakota State Building Code
Plumbing Code North Dakota State Plumbing Code (NDPC)
Electrical Code 2020 NFPA 70 National Electrical Code
Wiring Standards of North Dakota
Fuel Code 2024 International Fuel Gas Code (IFGC), as amended by the North Dakota State Building Code
Energy Code 2024 International Energy Conservation Code (IECC), as amended by the North Dakota State Building Code
Accessibility Code 2010 ADA and ICC A117.1 with Supplement 1
Life Safety Code 2012 NFPA 101 Life Safety Code
Design Guidelines 2014 FGI Guidelines for Hospitals and Outpatient Facilities, Chapter 2.4-2.14

CONSTRUCTION TYPE OF HOSPITAL

IBC: IIB at project area
NFPA: II(000)

OCCUPANCY CLASSIFICATION AT HOSPITAL AREA OF REMODEL

IBC: I-2, Condition 2
NFPA: New Healthcare

The Outpatient Clinic will be designated as a non-sleeping care suite.

SMOKE COMPARTMENTS

The maximum smoke compartment size is 22,500 SF for I-2 occupancies (IBC 407.5.1) and for New Healthcare occupancies (NFPA 18.3.7.1 (3))

This project will eliminate the psychiatric wing as having it's own smoke compartment. The updated smoke compartment size for this portion of the hospital will be 21,573 square feet.

The exit access travel distance for a smoke compartment shall not exceed 200 feet (IBC 407.5.2)
The maximum travel distance in this smoke compartment is 190 feet.

FIRE PROTECTION SYSTEM

NFPA 13 Sprinkler System

LOCKING FUNCTIONS AT ADULT PSYCHIATRIC UNIT

The two entry/exits for the Adult Psychiatric Unit will be secured at all times. Card readers will be utilized for both entry and exit of the units and these readers will be programmed for fail secure in the event of loss of power or a fire event. Staff at this unit will carry card readers and keys for the key override function at all times. This approach for the locking of the unit is allowable as per Section 1010.2.4 of the IBC and 18.2.2.6 of the NFPA.

Table with columns: Classification Type, Description, Occupant Load, Water Closets (Male/Female Required/Provided), Lavatories (Male/Female Required/Provided), Bathubs / Showers (Count/Req./Prov.), Drinking Fountains (Count/Req./Prov.), Other (Count/Req./Prov.).

DRINKING FOUNTAIN SUBSTITUTIONS:



As per the North Dakota State Plumbing Code, Section 415.2, a bottle filling station or water station can be substituted for a drinking fountain requirement.

At the Psychiatric unit, a bottle filling station is provided for the patients. For the employees, the refrigerator inside the Huddle room will utilize an integral water dispenser.

Table with columns: NUMBER, OCCUPANCY CLASSIFICATION, FUNCTION OF SPACE, SF PER OCC. LOAD, SF PER OCC. MEASUREMENT, OCCUPANT LOAD, REMARKS.

Table with columns: PATH ID, TRAVEL DISTANCE (TOTAL, MAX DIST., OCCUPANTS, OCC.), and specific path details like PU-1, PU-2, SC 1.4-1, etc.

LIFE SAFETY LEGEND section containing symbols and definitions for OCC. LOAD TAG, EGRESS DATA TAG, EGRESS DIRECTION SYMBOL, EGRESS SYMBOL, and FIRE-RESISTANCE RATINGS.

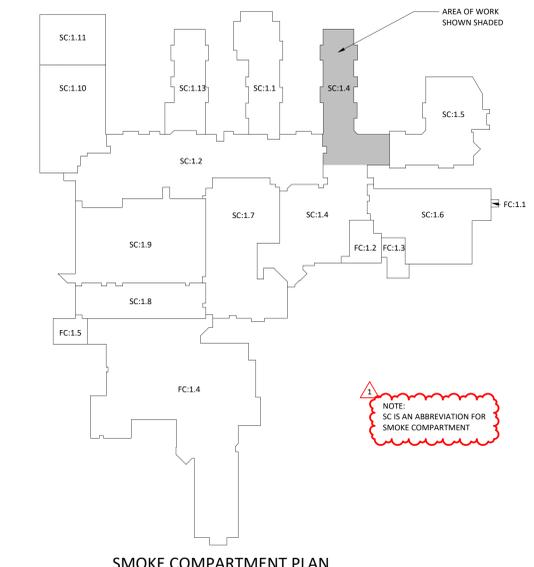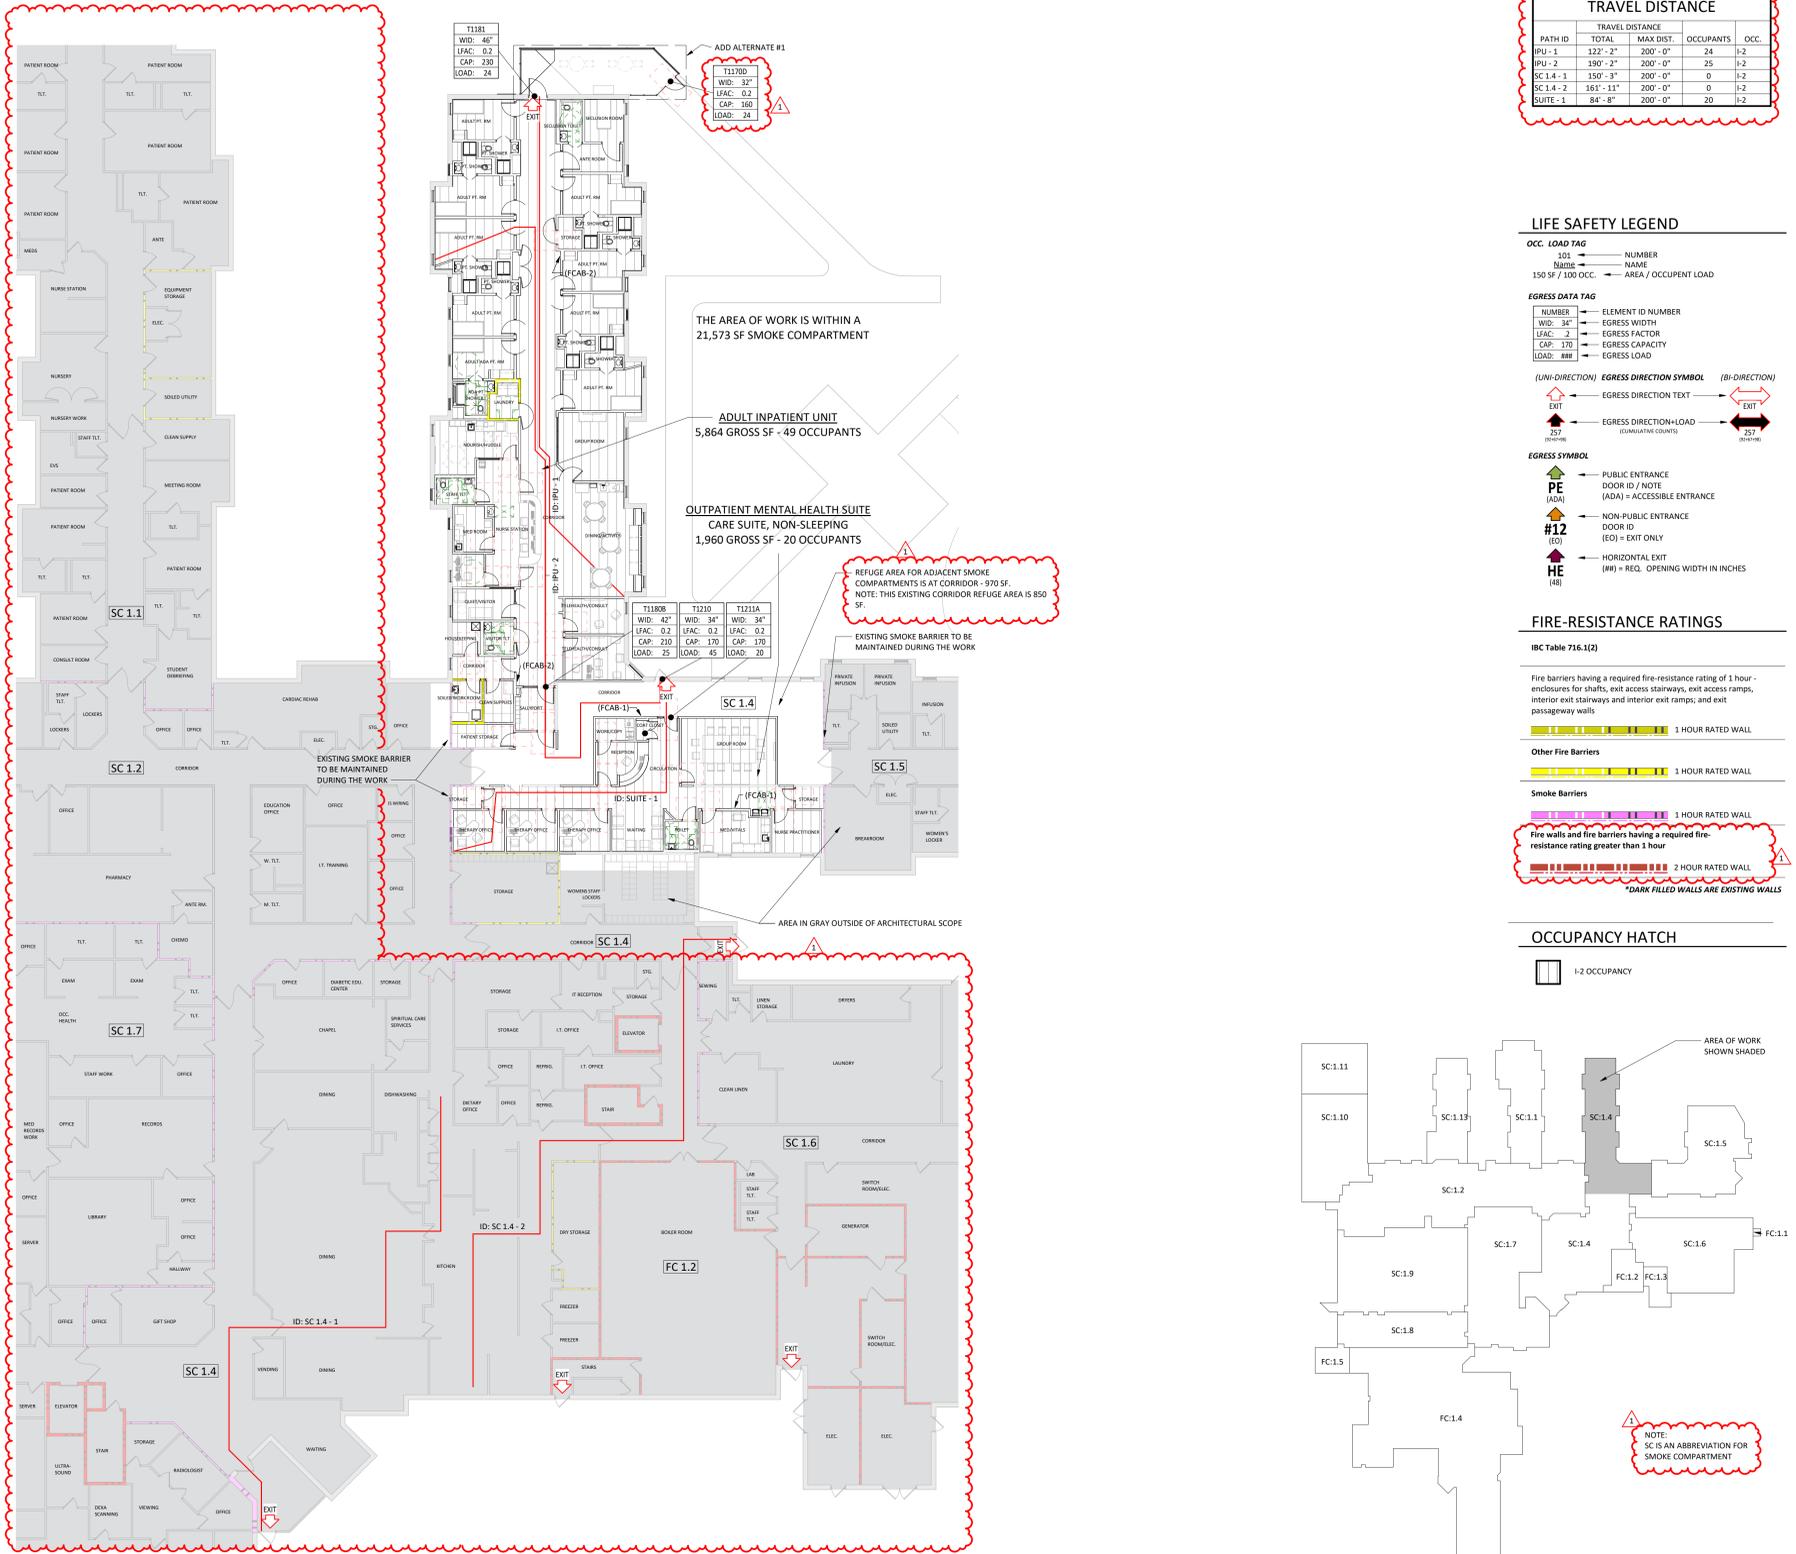




4A G111 FIRST LEVEL LIFE SAFETY PLAN - SMOKE COMPARTMENT 1.4 SCALE: 1/16" = 1'-0"



REVISION SCHEDULE table with columns: NO., DESCRIPTION, DATE.

CHI ST. ALEXIUS HEALTH - WILLISTON
CHI MENTAL HEALTH REMODEL
WILLISTON, ND

Project metadata including DATE (01/19/2026), PHASE (CONSTRUCTION DOCUMENTS), PROJECT (17153), SHEET (G111), and LIFE SAFETY PLAN & CODE REVIEW.

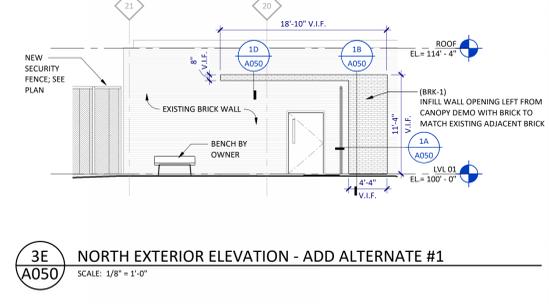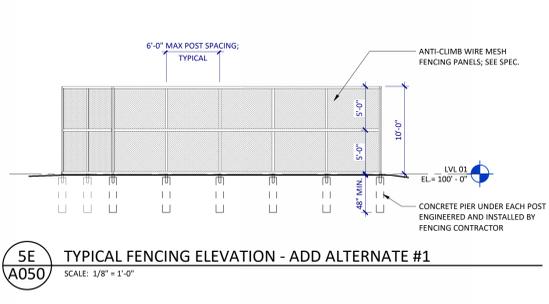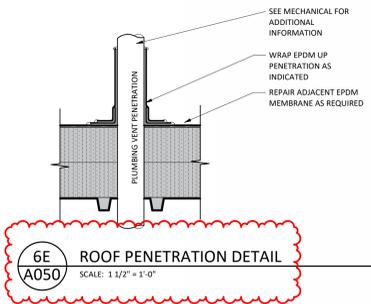

KEYNOTES - SITE PLAN & DEMO SITE PLAN

NO.	NOTE	REV.
1	ADD ALTERNATE #1: REMOVE AND DISCARD THE PORTION OF SIDEWALK SHOWN AS NEEDED FOR REMOVAL OF BRICK FINISHED MASONRY WALL AND ROOF.	
2	ADD ALTERNATE #1: SAWCUT AND DISCARD A PORTION OF THE CONCRETE STOOP AS NEEDED FOR DEMOLITION OF THE BRICK FINISHED MASONRY WALL AND FOUNDATION.	
3	ADD ALTERNATE #1: REMOVE AND DISCARD THE BRICK FINISHED MASONRY WALL AND FOOTING. DEMOLISH METAL ROOF AND FLASHING THAT EXTENDS FROM THE EXISTING BUILDING OVER THE MASONRY WALL.	
4	PROVIDE 4\"/>	
5	PROVIDE 3\"/>	
6	PROVIDE SECURITY GATE, 3\"/>	
7	REPLACE SOD AS NEEDED AFTER FENCE INSTALLATION.	
8	PROVIDE CONCRETE STOOP INFILL ADJACENT TO EXISTING STOOP. DOWEL SLAB INTO EXISTING STOOP SLAB. SLAB TO BE 5\"/>	
9	PROVIDE BLACK DIRT AND SOD AT DISTURBED AREA OF WORK REMOVAL. SLOPE AWAY FROM FOUNDATION.	
10	SITE FURNITURE BY OWNER.	

KEYNOTES - ROOF PLAN

NO.	NOTE	REV.
1	REMOVE A PORTION OF THE ROOF DECK AND EPDM ROOF FOR NEW DRYER EXHAUST PENETRATION. COORDINATE WITH MECHANICAL SCOPE.	
2	REMOVE RELIEF VENT - SEE MECHANICAL.	
3	SEE MECHANICAL FOR NEW DRYER EXHAUST PENETRATION. SEE DETAIL 6E/A050.	
4	PROVIDE METAL DECK INFILL WHERE RELIEF VENT WAS REMOVED. PROVIDE EPDM ROOFING INFILL, VAPOR RETARDER TO OVERLAP ADJACENT VAPOR RETARDER. PROVIDE INSULATION AT SAME SLOPE AS ADJACENT AND OVERLAP EPDM MEMBRANE WITH EXISTING FOR SMOOTH TRANSITION.	






JLG architects

225 Broadway N, Suite 700
 Fargo, ND 58102
 phone (701) 364-0237
 www.jlgarchitects.com
 copyright © 2026

REGISTERED ARCHITECT
 STATE OF NORTH DAKOTA
 (2139)
 3/19/2026

REVISION SCHEDULE

NO.	DESCRIPTION	DATE
1	ADDENDUM #1	02/03/26

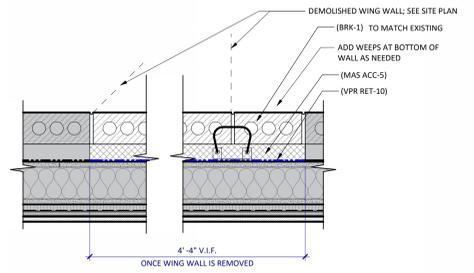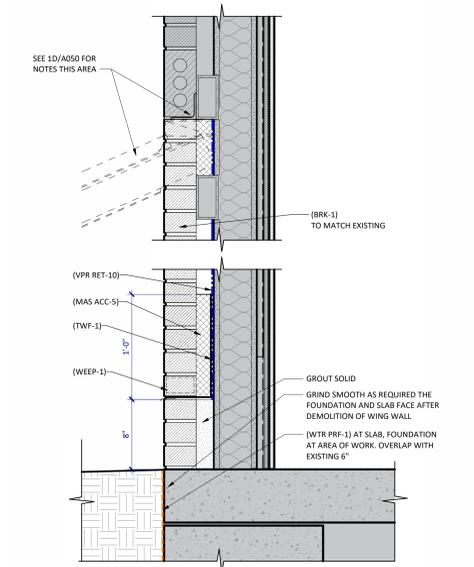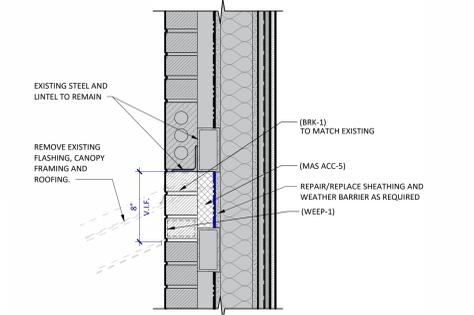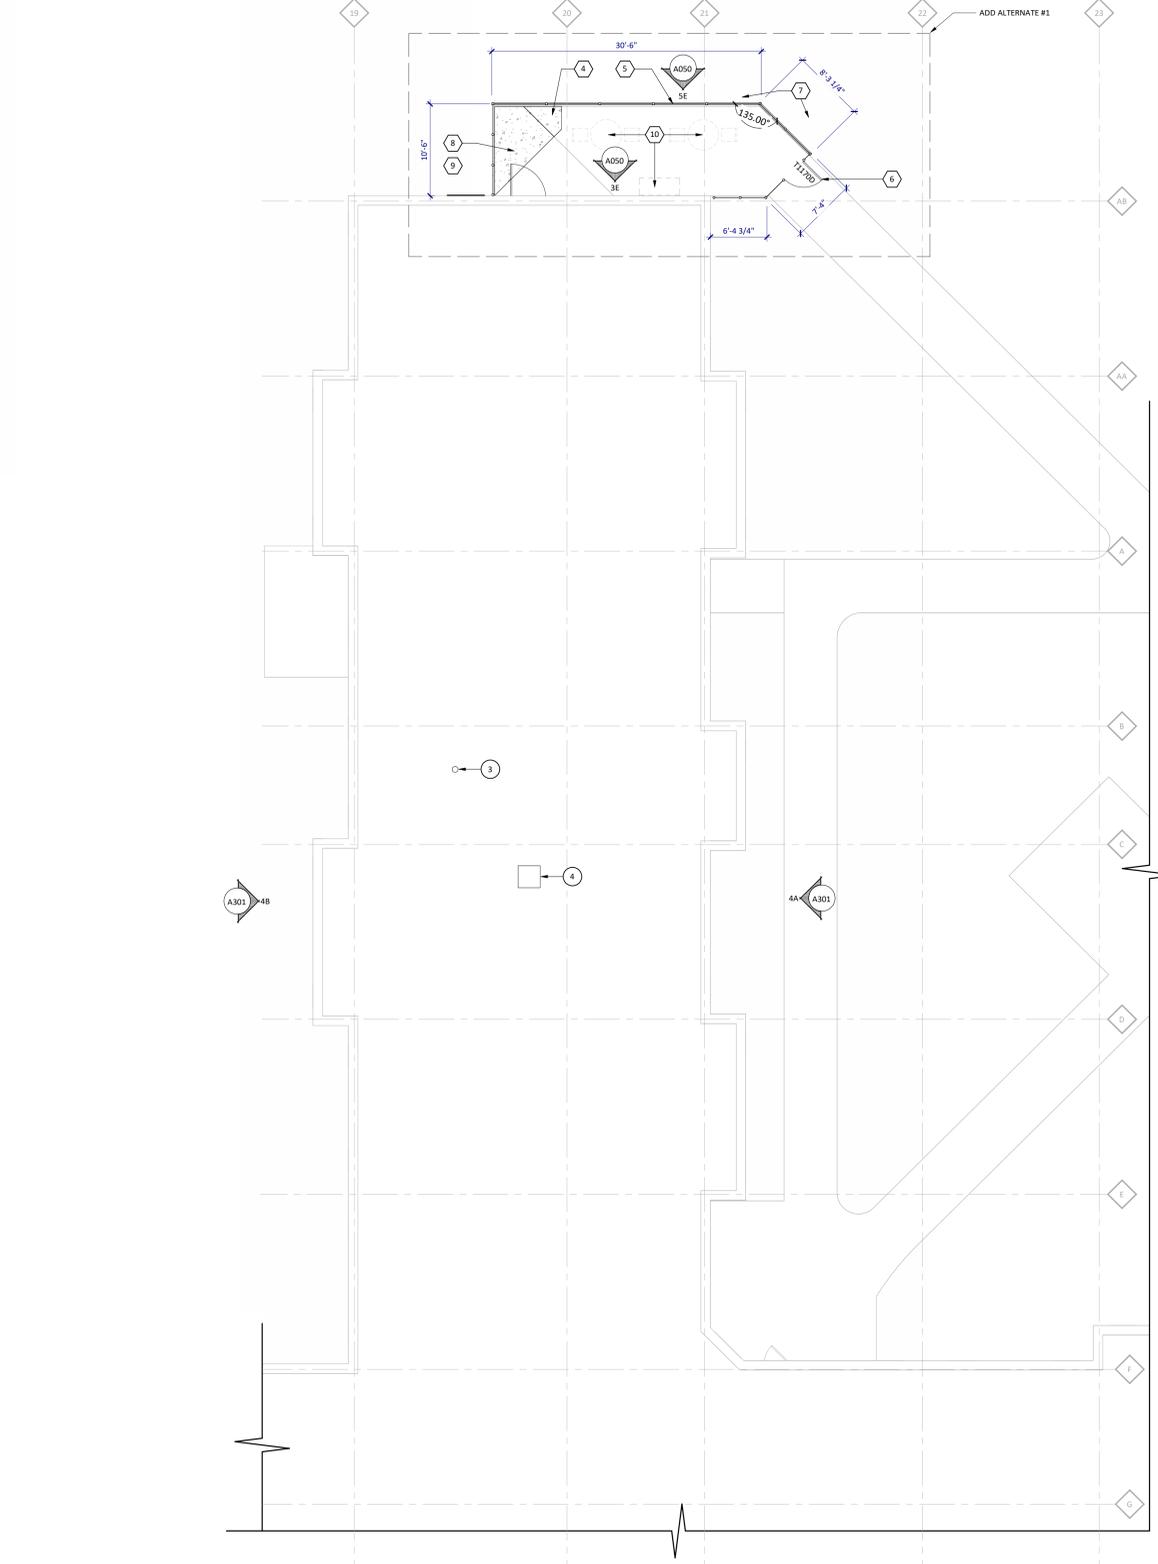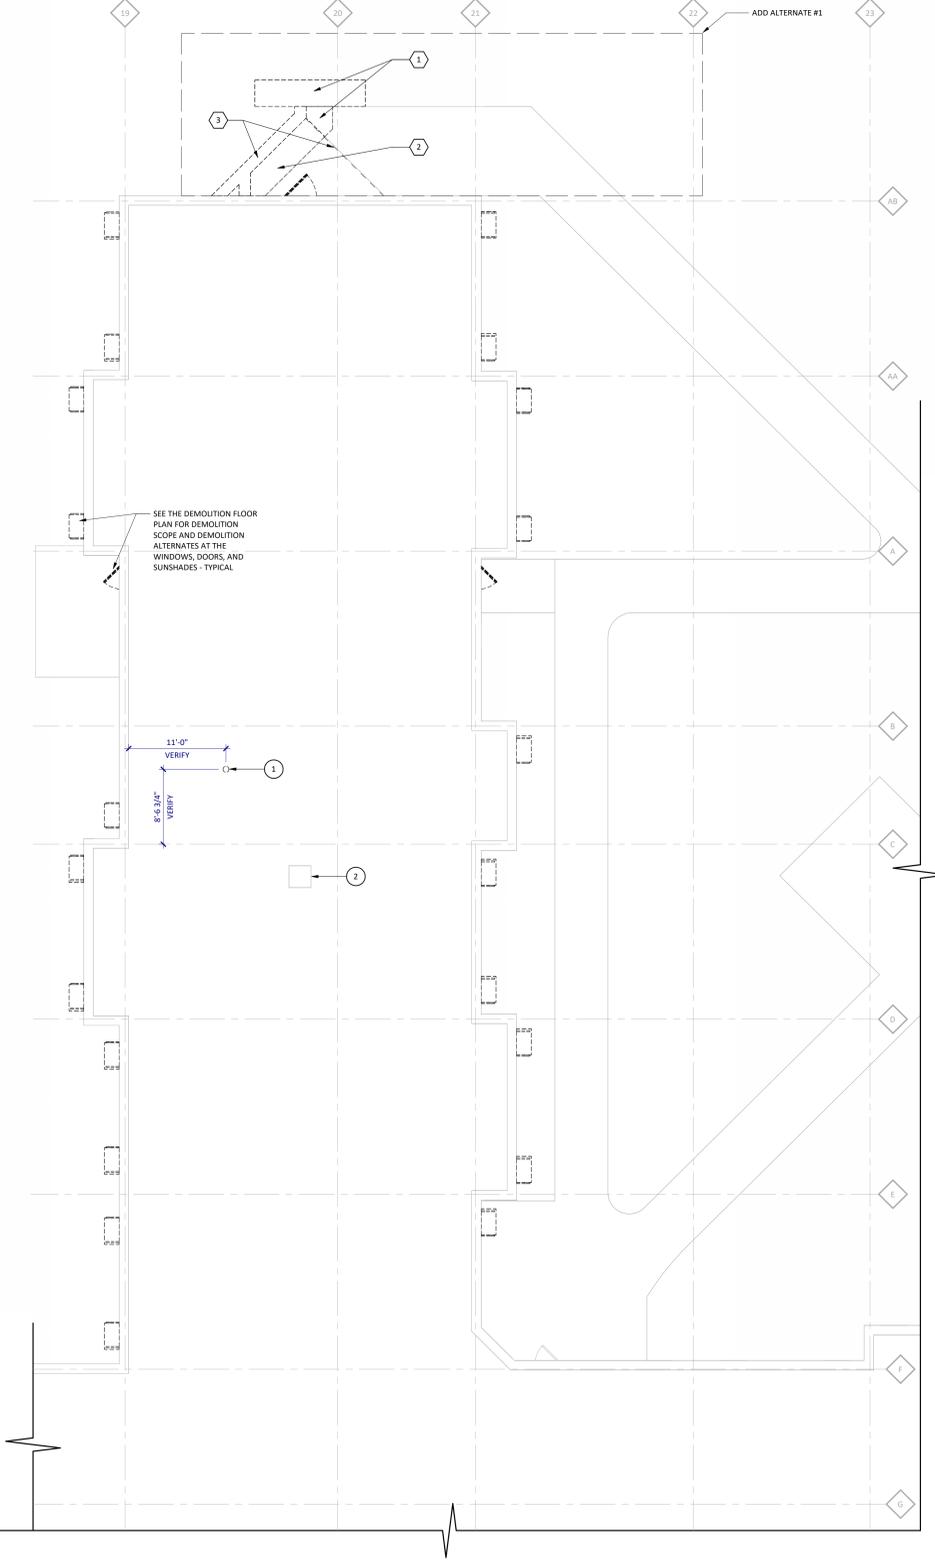

8A
A050
 PARTIAL ROOF AND SITE PLAN - DEMOLITION
 SCALE: 1/8" = 1'-0"

4A
A050
 PARTIAL ROOF AND SITE PLAN - NEW CONSTRUCTION
 SCALE: 1/8" = 1'-0"

1A
A050
 REMOVED WING WALL INFILL PLAN DTL - ADD ALT #1
 SCALE: 1 1/2" = 1'-0"

CHI ST. ALEXIUS HEALTH - WILLISTON
CHI MENTAL HEALTH REMODEL
 WILLISTON, ND

DATE
01/19/2026

PHASE
CONSTRUCTION DOCUMENTS

PROJECT
17153

SHEET
A050

ARCHITECTURAL
 SITE & ROOF PLAN

2/26/2026 2:59:31 PM

SHEET SPEC ID LIST	
SPEC ID	SPEC SECTION & DESCRIPTION
FCAB-1	10 4400 - FIRE EXTINGUISHER CABINET
FCAB-2	10 4400 - FIRE EXTINGUISHER CABINET



225 Broadway N, Suite 700
 Fargo, ND 58102
 phone (701) 364-0237
 www.jlgarchitects.com
 copyright © 2026



REVISION SCHEDULE		
NO.	DESCRIPTION	DATE
1	ADDENDUM #1	02/03/26

KEYNOTES - FLOOR PLAN		
NO	NOTE	REV.
01	REFER TO DRAWING 4E/A211 FOR TYPICAL PATIENT SHOWER ROOM (TO ALIGN WITH ROOM TAGS) DIMENSIONS, WALL TYPES, CONFIGURATION, AND EQUIPMENT. SOME ROOMS MAY BE MIRRORRED OR ROTATED. USE ORIENTATION ON SHEET A201.	
02	REFER TO ROOM 503 FOR TYPICAL PATIENT ROOM ELEVATIONS. SOME ROOMS MAY BE MIRRORRED OR ROTATED. USE ORIENTATION ON SHEET A201.	
03	INFILL OPENING IN EXISTING METAL STUD AND GWB WALL WITH METAL STUD CONSTRUCTION. MATCH EXISTING WIDTH. PATCH AND FEATHER GWB FINISH AS REQUIRED FOR SEAMLESS TRANSITION BETWEEN NEW WALL CONSTRUCTION AND EXISTING CONSTRUCTION.	
03.1	INFILL OPENING IN EXISTING METAL STUD AND GWB WALL WITH METAL STUD CONSTRUCTION AND TYPE "X" GYP BO. 1-HOUR RATED ASSEMBLY. MATCH EXISTING WIDTH. PATCH AND FEATHER GWB FINISH AS REQUIRED BETWEEN NEW WALL CONSTRUCTION AND EXISTING CONSTRUCTION.	
04	SEE MECHANICAL FOR INSTALLED DIMENSIONS. REFER TO 4A/A201 FOR CALLOUT LOCATIONS.	
05	AT HIGH RISK AREAS, PROVIDE GYP BD-11 AT EXISTING GYPSUM BOARD (AT EXPOSED EXTERIOR WALLS - TYPICAL. EXTEND TO RETURN FACE OF WINDOW OPENINGS AT HEAD AND JAMBS. EXTEND TO BOTTOM OF GYP BD CEILING).	
06A	ADD ALT #4A TO REPLACE EXISTING WINDOW SASH WITH NEW IN PATIENT ROOMS.	
06B	ADD ALT #4C. ADD NEW RETROFIT SECURITY SASH TO STAFF-ONLY MEDIUM RISK AREAS.	
06C	ADD ALT #4C. ADD NEW RETROFIT SECURITY SASH TO STAFF-ONLY SPACE.	
07	SEE THE SITE PLAN FOR ADD ALTERNATE #1 SCOPE.	
08	AT THE EXTERIOR WALL, REPAIR THE EXISTING VAPOR RETARDER AS REQUIRED AFTER DEMOLITION. PROVIDE GYPSUM BOARD INFILL AS REQUIRED FOR SMOOTH TRANSITION TO EXISTING ADJACENT GYPSUM BOARD.	
09	REPAIR EXISTING WALLS AS REQUIRED AFTER UNDERGROUND PLUMBING SCOPE AND NEW SLAB INSTALLATION IS COMPLETE.	
10	TRENCH DRAIN; SEE PLUMBING	
11	ADD NEW SECURITY SASH TO EXISTING WINDOW.	
12	PROVIDE NEW REINFORCED 4" SLAB ON GRADE AT AREA OF UNDERGROUND PLUMBING WORK. SEE DETAIL 7C/A501. PROVIDE VAPOR RETARDER BELOW SLAB, OVERLAP WITH EXISTING VAPOR RETARDER 4" MIN.	
13	SEE MECHANICAL FOR DRYER VENTING AND EXHAUST. SEE ROOF PLAN FOR EXHAUST.	
14	NOT USED	
15	BD ALT #5. DEDUCT ALTERNATE TO ELIMINATE THE BUILT-IN BENCH FROM THE ALCOVE.	
16	INTEGRAL BOWL SINK; SEE SPEC AND SEE MECH FOR TRIM AND PIPING.	
17	AT MEDIUM ACTIVE RISK AREAS, PROVIDE GYP BD-10 AT EXISTING GYPSUM BOARD AT EXPOSED EXTERIOR WALLS. TYPICAL. EXTEND TO RETURN FACE OF WINDOW OPENINGS AT HEAD AND JAMBS. EXTEND TO 6" ABOVE ACT. CEILING AND BOTTOM OF GYP BD CEILING.	
18	PROVIDE COAT HOOKS MOUNTED TO BACK WALL, (6) AT 66" AND (6) AT 44"	

- GENERAL NOTES - FLOOR PLAN**
- A. FOR TYPICAL BARRIER FREE TOILET ROOM TYPES AND ACCESSORIES REQUIREMENTS AND LOCATIONS SEE DWG G120.
 - B. FOR TYPICAL HOUSEKEEPING CLOSETS ACCESSORIES REQUIREMENTS AND MOUNTING LOCATIONS SEE DWG G120.
 - C. ALL PARTITION TYPES ARE "WA4" TYPICALLY UNLESS OTHERWISE NOTED.
 - D. COORDINATE PARTITION FIRE RATED REQUIREMENTS AS INDICATED ON LIFE SAFETY PLANS.
 - E. TYPICALLY INSTALL SOAP DISPENSERS AND PAPER TOWEL DISPENSER AT ALL SINKS UNLESS NOTED OTHERWISE.
 - F. PROVIDE WALL REINFORCEMENT PER DETAIL 2C/A620 AT WALL-MOUNTED SHELVES AND STORAGE UNITS, MARKER BOARDS, BULLETIN BOARDS, TACK BOARDS, TELEVISIONS AND OTHER CONTRACTOR OR OWNER FURNISHED WALL-MOUNTED ITEMS. REFER TO ACCESSORIES AND EQUIPMENT SCHEDULES SEE DWG A601.
 - G. FOR ALL CARPET TYPE CHANGES BETWEEN ROOMS, TRANSITION SHALL OCCUR AT CENTERLINE OF DOOR PANEL TYPICALLY - U.N.O. SEE DWG A600.
 - H. COORDINATE DIMENSIONS W/ ASTERISK (*) - 4" X 4" W/ EQUIPMENT VENDOR.
 - I. FOR INTERIOR METAL STUD CONSTRUCTION ALL DIMENSIONS ARE TO FACE OF METAL STUDS UNLESS NOTED OTHERWISE.
 - J. ALL DIMENSIONS INDICATED AS CLEAR ARE TO FACE OF FINISH GYPSUM, TILE, ETC.).
 - K. ALL MASONRY DIMENSIONS ARE TO FACE OF MASONRY UNLESS NOTED OTHERWISE.
 - L. ALL EXTERIOR OPENING DIMENSIONS ARE ROUGH OPENINGS.
 - M. COORDINATE ALL FLOOR OPENING DIMENSIONS AND CLEARANCES FOR DUCTWORK W/ MECHANICAL CONTRACTOR - TYPICAL.
 - N. COORDINATE AND/OR CONFIRM ANY DIMENSIONAL DISCREPANCIES WITH ARCHITECT PRIOR TO INSTALLATION.

INTERIOR PARTITION LEGEND

EX-103

NUMBER INDICATES REQUIRED RATING:
 "1" = 1 HOUR RATING IN COMPLIANCE WITH UL RATING U465

NUMBER INDICATES SIZE OF STUD:
 "0" - NO STUD, ADDED LAYER OF GYPSUM ONLY ON EXISTING WALL
 "2" = 1-5/8" METAL STUD
 "4" = 3-5/8" METAL STUD
 "6" = 6" METAL STUD
 "8" = 8" METAL STUD

LETTERS) A, B, C, D INDICATE THE LAYERS OF WALL GYPSUM PER RISK LEVEL TYPE. IF LETTERS ARE NOTED, THIS INDICATES DIFFERING RISK LEVELS ON EACH SIDE OF WALL. REFER TO RISK PLAN FOR DETERMINING THE APPROPRIATE RISK LEVEL ON EACH SIDE OF WALL.

"F" PREFIX INDICATES A FURRING WALL CORE
 "W" INDICATES SOUND INSULATION WALL CORE

FIRE-RESISTANCE RATINGS

IBC Table 716.1(2)



Fire barriers having a required fire-resistance rating of 1 hour - enclosures for shafts, exit access stairways, exit access ramps, interior exit stairways and interior exit ramps; and exit passageway walls

Other Fire Barriers
 1 HOUR RATED WALL


Smoke Barriers
 1 HOUR RATED WALL

Fire walls and fire barriers having a required fire-resistance rating greater than 1 hour
 2 HOUR RATED WALL

*DARK FILLED WALLS ARE EXISTING WALLS

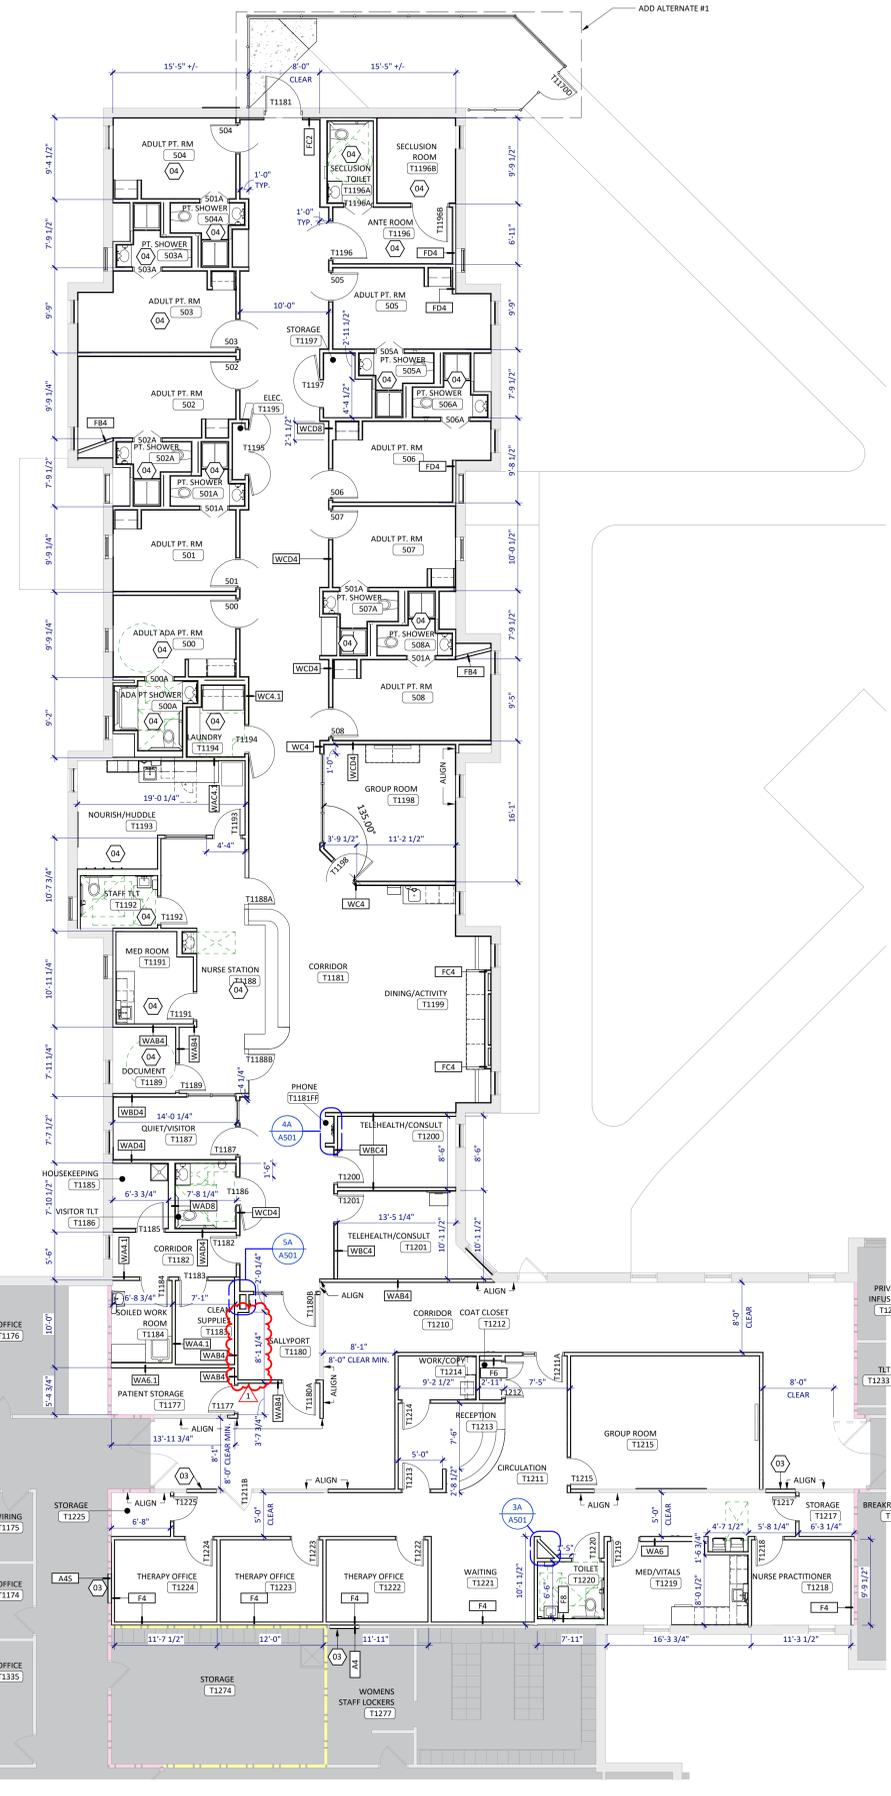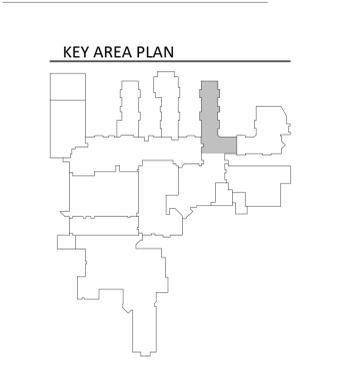

7A A201
 PARTIAL FIRST LEVEL FLOOR PLAN - ADULT PSYCHIATRIC UNIT AND OUTPATIENT SUITE - DIMENSIONS AND PARTITION TAGS
 SCALE: 1/8" = 1'-0"

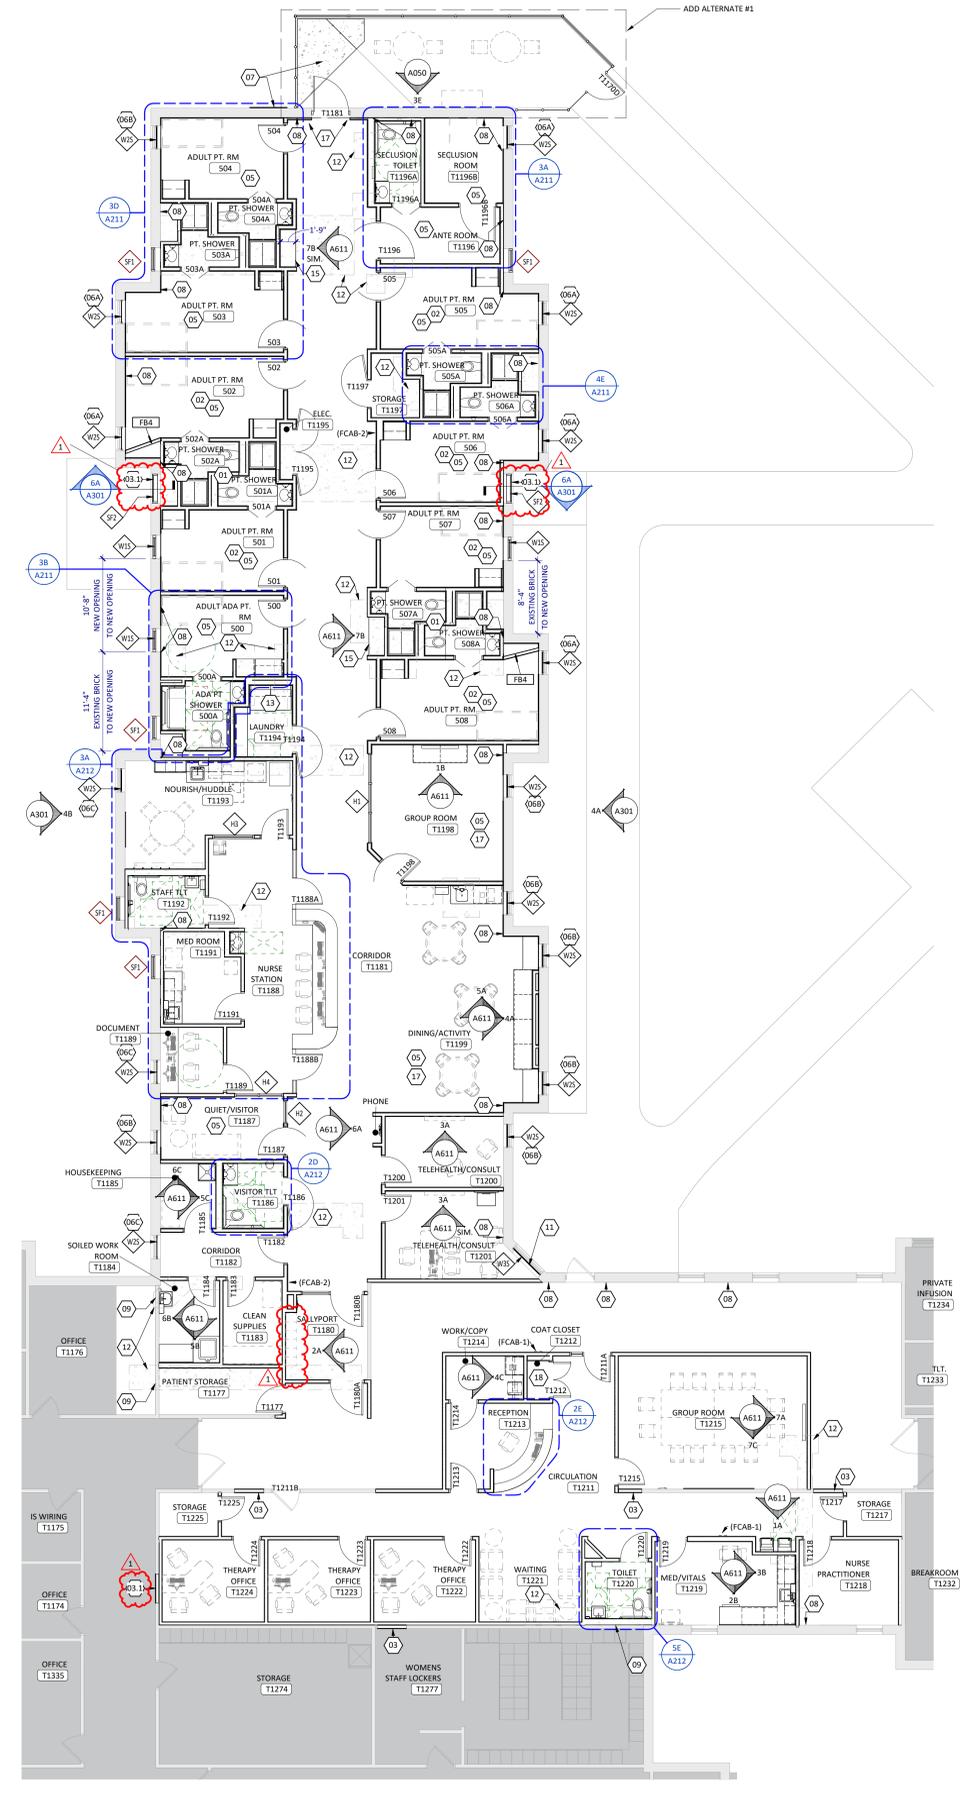

4A A201
 PARTIAL FIRST LEVEL FLOOR PLAN - ADULT PSYCHIATRIC UNIT AND OUTPATIENT SUITE
 SCALE: 1/8" = 1'-0"

CHI ST. ALEXIUS HEALTH - WILLISTON
CHI MENTAL HEALTH REMODEL
 WILLISTON, ND

DATE: 01/19/2026
 PHASE: CONSTRUCTION DOCUMENTS
 PROJECT: 17153
 SHEET: **A201**
 FLOOR PLAN & DIMENSION PLAN

2/26/2026 2:59:41 PM




REVISION SCHEDULE


NO.	DESCRIPTION	DATE
1	ADDENDUM #1	02/03/26

SHEET SPEC ID LIST


SPEC ID	SPEC SECTION & DESCRIPTION
DPNL-1	06 4100 - PLAM ON MDF SUBSTRATE
DPNL-2	06 4100 - PLAM ON MDF SUBSTRATE
GB-18	10 2800 - GRAB BAR, 18 INCHES
GB-36	10 2800 - GRAB BAR, 36 INCHES
GB-42	10 2800 - GRAB BAR, 42 INCHES
HK-1	10 2800 - COAT/ROBE HOOK, SINGLE PRONG
MIR-10	10 2800 - MIRROR, ANGLE FRAMED
MRKBD-1	10 1100 - MARKER BOARD
MT-1	09 3000 - TILE TRIM
MT-2	09 3000 - TILE TRIM
PT-4	09 9123 - PAINT
PT-6	09 9123 - PAINT
PTD-1	10 2800 - PAPER TOWEL DISPENSER, C-FOLD
RB-1	09 6500 - RESILIENT BASE
SCB-18	10 2800 - PSYCHIATRIC GRAB BAR, 18 INCHES
SCB-36	10 2800 - PSYCHIATRIC GRAB BAR, 36 INCHES
SCB-42	10 2800 - PSYCHIATRIC GRAB BAR, 42 INCHES
SMIR-10	10 2800 - PSYCHIATRIC MIRROR
SP-1	10 2800 - SOAP DISPENSER, WALL MOUNT
SPFD-1	10 2800 - PSYCH TOILET PAPER DISPENSER, ROLL TYPE
SSM-1	12 3600 - SOLID SURFACE COUNTERTOP
SSM-2	12 3600 - SOLID SURFACE COUNTERTOP
SSM-3	12 3600 - SOLID SURFACE COUNTERTOP
SSP-1	10 2800 - PSYCHIATRIC SOAP DISPENSER, WALL MOUNT
STP-1	10 2800 - PSYCH TOILET PAPER DISPENSER, SINGLE ROLL
T-2	09 3000 - TILE
TB-1	09 3000 - TILE BASE
TP-1	10 2800 - TOILET PAPER DISPENSER, SINGLE ROLL




8E
A212 OUTPATIENT TOILET - W ELEV.
SCALE: 1/4" = 1'-0"




7E
A212 OUTPATIENT TLT - S ELEV.
SCALE: 1/4" = 1'-0"




6E
A212 OUTPATIENT TLT - E ELEV.
SCALE: 1/4" = 1'-0"




5E
A212 ENLARGED PLAN - OUTPATIENT TOILET
SCALE: 1/4" = 1'-0"



4E
A212 RECEPTION - E ELEV.
SCALE: 1/4" = 1'-0"



3E
A212 RECEPTION - W ELEV.
SCALE: 1/4" = 1'-0"



2E
A212 ENLARGED PLAN - OUTPATIENT RECEPTION
SCALE: 1/4" = 1'-0"

KEYNOTES - INTERIOR ELEV.

NO.	NOTE	REV.
01	EXISTING WINDOW TO REMAIN.	
02	GRAIN PATTERN OF PLAM SHALL RUN VERTICALLY TO MATCH CABINET DOORS. PROVIDE FLUSH SEAMS AS REQUIRED IN PANELS.	


KEYNOTES - FLOOR PLAN

NO.	NOTE	REV.
01	REFER TO DRAWING 4E/A211 FOR TYPICAL PATIENT SHOWER ROOM (TO ALIGN WITH ROOM TAGS) DIMENSIONS, WALL TYPES, CONFIGURATION, AND EQUIPMENT. SOME ROOMS MAY BE MIRRORRED OR ROTATED. USE ORIENTATION ON SHEET A201.	
02	REFER TO ROOM 505 FOR TYPICAL PATIENT ROOM ELEVATIONS. SOME ROOMS MAY BE MIRRORRED OR ROTATED. USE ORIENTATION ON SHEET A201.	
03	INFILL OPENING IN EXISTING METAL STUD AND GWB WALL WITH METAL STUD CONSTRUCTION. MATCH EXISTING WIDTH. PATCH AND FEATHER GWB FINISH AS REQUIRED FOR SEAMLESS TRANSITION BETWEEN NEW WALL CONSTRUCTION AND EXISTING CONSTRUCTION.	
03.1	INFILL OPENING IN EXISTING BATED METAL STUD AND GWB WALL WITH METAL STUD CONSTRUCTION AND TYPE "X" GYP BD. 1-HOUR RATED ASSEMBLY. MATCH EXISTING WIDTH. PATCH AND FEATHER GWB FINISH AS REQUIRED BETWEEN NEW WALL CONSTRUCTION AND EXISTING CONSTRUCTION.	
04	SEE ENLARGED PLANS FOR WALL TAGS AND DETAILED DIMENSIONS. REFER TO 4A/A212 FOR CALLOUT LOCATIONS.	
05	AT HIGH RISK AREAS, PROVIDE (GYP BD-11) AT EXISTING GYPSUM BOARD AT EXPOSED EXTERIOR WALLS - TYPICAL. EXTEND TO RETURN FACE OF WINDOW OPENINGS AT HEAD AND JAMBS. EXTEND TO BOTTOM OF GYP BD CEILINGS.	
06A	ADD ALT #4A TO REPLACE EXISTING WINDOW SASH WITH NEW IN PATIENT ROOMS	
06B	ADD ALT #4B TO REPLACE EXISTING WINDOW SASH WITH NEW AT MEDIUM RISK AREAS.	
06C	ADD ALT #4C. ADD NEW RETROFIT SECURITY SASH TO STAFF-ONLY SPACE.	
07	SEE THE SITE PLAN FOR ADD ALTERNATE #1 SCOPE.	
08	AT THE EXTERIOR WALL, REPAIR THE EXISTING VAPOR RETARDER AS REQUIRED AFTER DEMOLITION. PROVIDE GYPSUM BOARD INFILL AS REQUIRED FOR SMOOTH TRANSITION TO EXISTING ADJACENT GYPSUM BOARD.	
09	REPAIR EXISTING WALL AS REQUIRED AFTER UNDERGROUND PLUMBING SCOPE AND NEW SLAB INSTALLATION IS COMPLETE.	
10	TRENCH DRAIN; SEE PLUMBING.	
11	ADD NEW SECURITY SASH TO EXISTING WINDOW.	
12	PROVIDE NEW REINFORCED 4" SLAB ON GRADE AT AREA OF UNDERGROUND PLUMBING WORK. SEE DETAIL 72/ASD. PROVIDE VAPOR RETARDER BELOW SLAB, OVERLAP WITH EXISTING VAPOR RETARDER 4" MIN.	
13	SEE MECHANICAL FOR DRYER VENTING AND EXHAUST. SEE ROOF PLAN FOR EXHAUST.	
14	NOT USED	
15	BD AT #5. DEDUCT ALTERNATE TO ELIMINATE THE BUILT-IN BENCH FROM THE ALCOVE.	
16	INTEGRAL BOWL SINK; SEE SPEC AND SEE MECH FOR TRIM AND PIPING.	
17	AT MEDIUM ACTIVE RISK AREAS, PROVIDE (GYP BD-10) AT EXISTING GYPSUM BOARD AT EXPOSED EXTERIOR WALLS - TYPICAL. EXTEND TO RETURN FACE OF WINDOW OPENINGS AT HEAD AND JAMBS. EXTEND TO 6" ABOVE ACT CEILINGS AND BOTTOM OF GYP BD CEILINGS.	
18	PROVIDE COAT HOOKS MOUNTED TO BACK WALL (E) AT 60" AND (G) AT 60".	


GENERAL NOTES - INTERIOR ELEVATIONS

A. REFER TO ADD FOR STANDARD CASEWORK ELEVATIONS AND CONSTRUCTION.
 B. ALL WALL SURFACES TO BE (PT-1) UNLESS NOTED OTHERWISE.
 C. PROVIDE LEVEL "S" DRYWALL FINISH AT ALL APPLIED GRAPHICS AND WRITABLE WALL SURFACE LOCATIONS.
 D. PROVIDE WALL REINFORCEMENT AT ALL WALL MOUNTED ITEMS.
 E. ANY EXPOSED CABINET EDGE SHALL BE FINISHED EDGE TO MATCH ADJACENT CABINET FINISH.
 F. SEE SHEET G120 FOR ALL TOILET RIM HEIGHTS AND ACCESSORY MOUNTING HEIGHTS.


E1 - EQUIPMENT TAG - REFER TO SPECIALTY EQUIPMENT SCHEDULE ON SHEET A801 FOR SPECIFIC INFORMATION AND PROVIDER




5D
A212 VISITOR TLT - S ELEV.
SCALE: 1/4" = 1'-0"




4D
A212 VISITOR TLT - W ELEV.
SCALE: 1/4" = 1'-0"




3D
A212 VISITOR TLT - N ELEV.
SCALE: 1/4" = 1'-0"




2D
A212 ENLARGED PLAN - VISITOR TLT
SCALE: 1/4" = 1'-0"

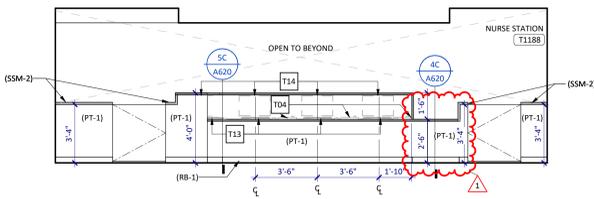


6C
A212 NURSE STATION - E ELEV.
SCALE: 1/4" = 1'-0"

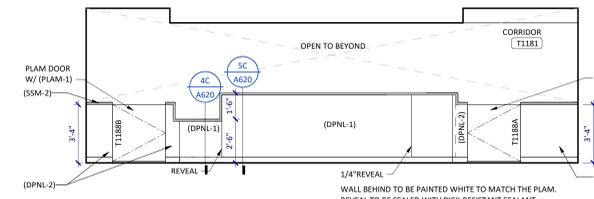


4C
A212 NURSE STATION - W ELEV.
SCALE: 1/4" = 1'-0"




8B
A212 NURSE STATION SINK - W ELEV.
SCALE: 1/4" = 1'-0"




7B
A212 STAFF TLT - W ELEV.
SCALE: 1/4" = 1'-0"




6B
A212 STAFF TLT - N ELEV.
SCALE: 1/4" = 1'-0"




5B
A212 STAFF TLT - E ELEV.
SCALE: 1/4" = 1'-0"




4B
A212 MED ROOM - W ELEV.
SCALE: 1/4" = 1'-0"




3B
A212 LAUNDRY - N ELEV.
SCALE: 1/4" = 1'-0"




8A
A212 LAUNDRY - W ELEV.
SCALE: 1/4" = 1'-0"




7A
A212 HUDDLE - E ELEV.
SCALE: 1/4" = 1'-0"




6A
A212 NOURISH/HUDDLE - W ELEV.
SCALE: 1/4" = 1'-0"



5A
A212 HUDDLE - S ELEV.
SCALE: 1/4" = 1'-0"



4A
A212 HUDDLE - N ELEV.
SCALE: 1/4" = 1'-0"

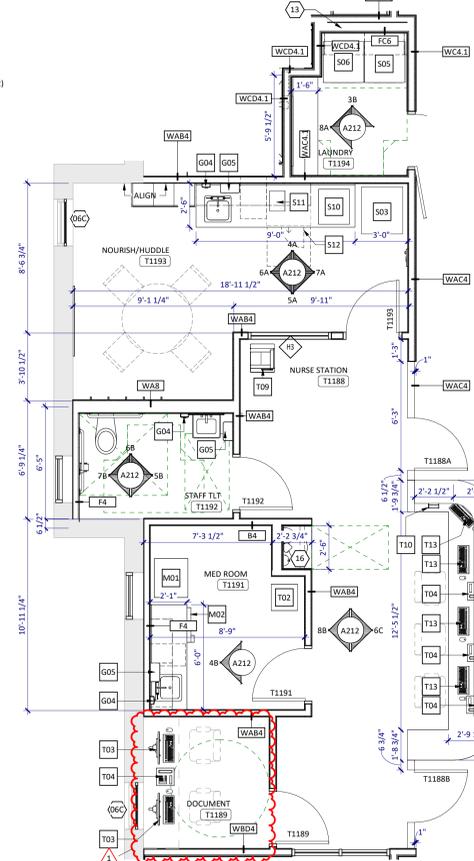

3A
A212 ENLARGED PLAN - STAFF WORK AREA
SCALE: 1/4" = 1'-0"

NUMBER	HW SET	RATING	ROOM NAME	PANEL SIZE (F) = UNEQUAL PANELS		HEIGHT	THK	DOOR TYPE	PANEL INFO			FRAME INFO			DETAIL INFO		SRL	COMMENTS	REV.	
				PANEL 1	PANEL 2				MAT'L	FINISH	GLZ	FRAME TYPE	MAT'L	FINISH	GLZ	JAMB				HEAD
500	07	--	ADULT ADA PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
500A	--	--	ADA PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
501	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
501A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
502	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
502A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
503	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
503A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
504	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
504A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
505	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
505A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
506	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
506A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
507	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
507A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
508	07	--	ADULT PT. RM	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
508A	--	--	PT. SHOWER	3'-0"		7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
T1170D	11	--	ADD ALT COURTYARD	3'-0"	3'-0"	7'-0"	1 3/4"	FG	HM	PREFIN	--	--	HM	PT-1	--	--	--	--	ADD ALTERNATE - FENCE GATE. EXTERIOR LEVER LOCKSET, STORAGE FUNCTION	
T1177	17	--	PATIENT STORAGE	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	CARD READER	
T1180A	17	--	SALLYPORT	3'-8"	3'-8"	7'-0"	1 3/4"	N	HM	PREFIN	SEC GL-1	1	HM	PT-1	SEC GL-1	4A/A220	4B/A220	--	CARD READERS, FAIL SECURE FOR EGRESS	
T1180B	24	--	SALLYPORT	3'-8"	3'-8"	7'-0"	1 3/4"	G	WD	PREFIN	SEC GL-1	2	HM	PT-1	SEC GL-1	4A/A220	4B/A220	1C/A220	CARD READER	
T1181	23	--	CORRIDOR	4'-0"	4'-0"	7'-0"	1 3/4"	N	HM	PT-1 INT, PT-7 EXT	GL-1	1	EXIST	EXIST	--	--	--	--	NEW DOOR IN EXISTING FRAME. ANTI-LIGATURE DOOR HARDWARE, CARD READERS - FAIL SECURE FOR EGRESS.	
T1182	21	--	CORRIDOR	3'-0"	3'-0"	7'-0"	1 3/4"	G	WD	PREFIN	SEC GL-1	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1183	08	--	CLEAN SUPPLIES	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	CARD READER	
T1184	06	45 MIN.	SOLED WORK ROOM	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1185	08	--	HOUSEKEEPING	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1186	16	--	VISITOR TLT	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1187	13	--	QUIET/VISITOR	3'-0"	3'-0"	7'-0"	1 3/4"	FG	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, ANTI-BARRICADE FRAME	
T1188A	04	--	NURSE STATION	3'-0"	3'-0"	3'-4"	1 3/4"	F	PLAM-1	PREFIN	--	--	--	--	--	--	--	--		
T1188B	04	--	NURSE STATION	3'-0"	3'-0"	3'-4"	1 3/4"	F	PLAM-1	PREFIN	--	--	--	--	--	--	--	--		
T1189	20	--	DOCUMENT	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1191	19	--	MED ROOM	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1192	25	--	START TLT	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1193	19	--	NOURISH/BUDDLE	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1194	21	--	LAUNDRY	3'-0"	3'-0"	7'-0"	1 3/4"	G	WD	PREFIN	FR SEC GL-1	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1195	14	--	ELEC.	5'-0"	2'-6"	2'-6"	1 3/4"	F/F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1196	22	--	ANTE ROOM	4'-0"	4'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	2B, 3B/A220	1B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER, ANTI-BARRICADE FRAME	
T1196A	--	--	SECLUSION TOILET	3'-0"	3'-0"	7'-0"	1 3/4"	F	--	--	--	1	HM	PT-1	--	2A/A220	1A/A220	--	SOFT CORE DOOR	
T1196B	26	--	SECLUSION ROOM	4'-0"	4'-0"	7'-0"	1 3/4"	G	WD	PREFIN	SEC GL-1	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1197	19	--	STORAGE	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1198	13	--	GROUP ROOM	3'-0"	3'-0"	7'-0"	1 3/4"	FG	WD	PREFIN	SEC GL-1	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1200	19	--	TELEHEALTH/CONSULT	3'-0"	3'-0"	7'-0"	1 3/4"	N	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1201	19	--	TELEHEALTH/CONSULT	3'-0"	3'-0"	7'-0"	1 3/4"	N	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1211A	17	--	CORRIDOR	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	2	HM	PT-1	--	4A/A220	4B/A220	--	CARD READER	
T1211B	03	--	CIRCULATION	3'-0"	3'-0"	7'-0"	1 3/4"	(EXIST)	--	(EXIST)	--	--	HM	PT-1	--	--	--	--		
T1212	15	--	COAT CLOSET	4'-0"	4'-0"	7'-0"	1 3/4"	F-F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1213	18	--	RECEPTION	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1214	18	--	WORK/COPY	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	CARD READER	
T1215	01	--	GROUP ROOM	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1217	10	--	STORAGE	3'-8"	3'-8"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1218	05	--	NURSE PRACTITIONER	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1219	17	--	MED/VITALS	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	CARD READER	
T1220	09	--	TOILET	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE, CARD READER	
T1222	05	--	THERAPY OFFICE	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1223	05	--	THERAPY OFFICE	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1224	05	--	THERAPY OFFICE	3'-0"	3'-0"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	
T1225	10	--	STORAGE	2'-8"	2'-8"	7'-0"	1 3/4"	F	WD	PREFIN	--	1	HM	PT-1	--	4A/A220	4B/A220	--	ANTI-LIGATURE DOOR HARDWARE	


SHEET SPEC ID LIST	
SPEC ID	SPEC SECTION & DESCRIPTION
HM	08 1213 - HOLLOW METAL FRAMES
SEALANT-1	07 9200 - JOINT SEALANT OR CAULKING WITH OR WITHOUT BACKER ROD
SEC GL-1	08 8000 - LAMINATED SECURITY GLAZING

JLG architects

225 Broadway N, Suite 700
 Fargo, ND 58102
 phone (701) 364-0237
 www.jlgarchitects.com
 copyright © 2026


REGISTERED ARCHITECT
 STATE OF NORTH DAKOTA
 (2139)
 3/19/2026

REVISION SCHEDULE		
NO.	DESCRIPTION	DATE
1	ADDENDUM #1	02/03/26

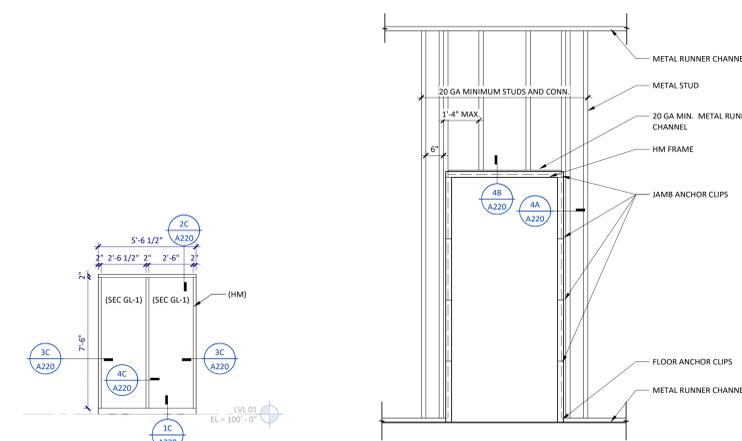


3E A220 H4 SCALE: 1/4" = 1'-0"


2E A220 DOOR FRAMING ELEVATION SCALE: 1/2" = 1'-0"




3D A220 H1 SCALE: 1/4" = 1'-0"




2D A220 H2 SCALE: 1/4" = 1'-0"




1D A220 H3 SCALE: 1/4" = 1'-0"



5C A220 DOOR LOCATION PLAN - TYP SCALE: 1 1/2" = 1'-0"



4C A220 HM MULLION SCALE: 1 1/2" = 1'-0"



SHEET SPEC ID LIST	
SPEC ID	SPEC SECTION & DESCRIPTION
FCAB-1	10 4400 - FIRE EXTINGUISHER CABINET
MET STUD-2	09 2316 - NON-LOADBEARING METAL STUDS, 20 GA.
SEALANT-1	07 9300 - JOINT SEALANT OR CAULKING WITH OR WITHOUT BACKER ROD
VPR-RET-3	03 3000 - 10 MIL UNDERSLAB VAPOR RETARDER




225 Broadway N, Suite 700
 Fargo, ND 58102
 phone (701) 364-0237
 www.jlgarchitects.com
 copyright © 2026

GENERAL NOTES - INTERIOR DETAILS


A. ALL SEALANT INSIDE OF THE ADULT PSYCHIATRIC UNIT AT HIGH AND MEDIUM RISK AREAS TO BE TAMPER RESISTANT/PICK PROOF. SEE THE SECURITY PROVISIONS PLAN FOR LOCATIONS.




REVISION SCHEDULE		
NO.	DESCRIPTION	DATE
1	ADDENDUM #1	02/03/26

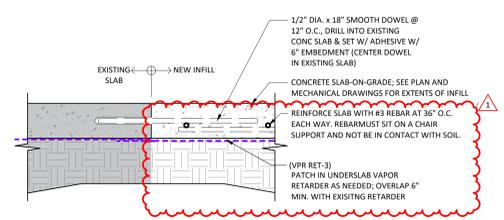


7C SLAB INFILL DETAIL
 SCALE: 1 1/2" = 1'-0"

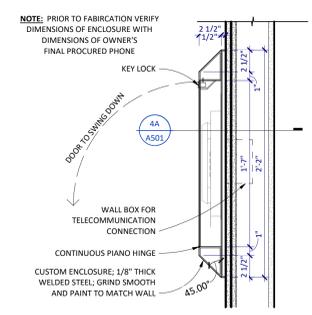


4B PHONE ENCLOSURE DETAIL - SECTION
 SCALE: 1 1/2" = 1'-0"

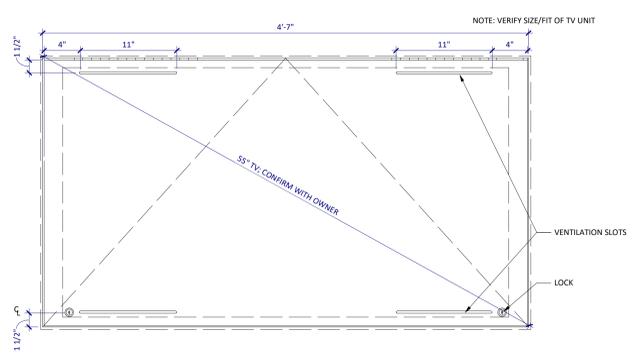


7B ELEVATION, RECESSED TV ENCLOSURE
 SCALE: 1 1/2" = 1'-0"

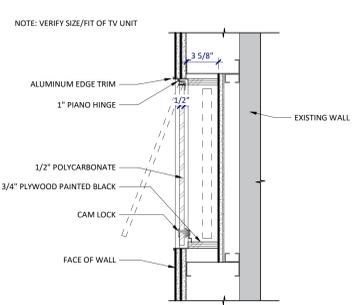


7A SECTION DETAIL, RECESSED TV ENCLOSURE
 SCALE: 1 1/2" = 1'-0"

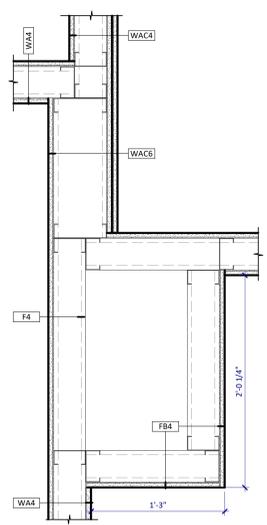


5A PLAN SECTION AT SALLYPORT
 SCALE: 1 1/2" = 1'-0"

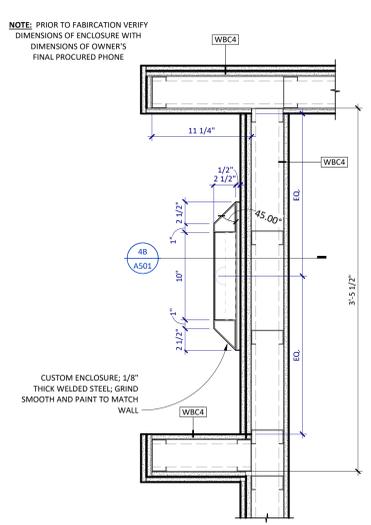


4A PLAN SECTION AT PHONE
 SCALE: 1 1/2" = 1'-0"

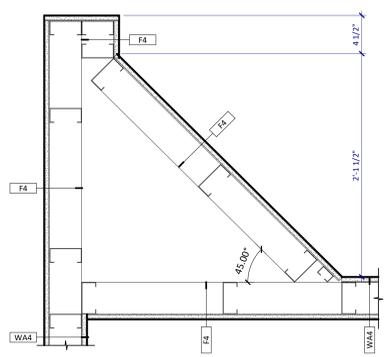

3A PLAN SECTION AT OUTPATIENT SUITE
 SCALE: 1 1/2" = 1'-0"

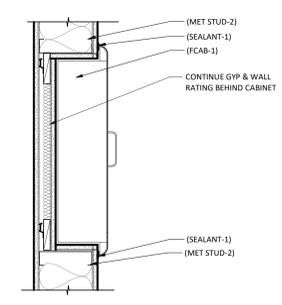

1A SEMI RECESSED FXC
 SCALE: 1 1/2" = 1'-0"

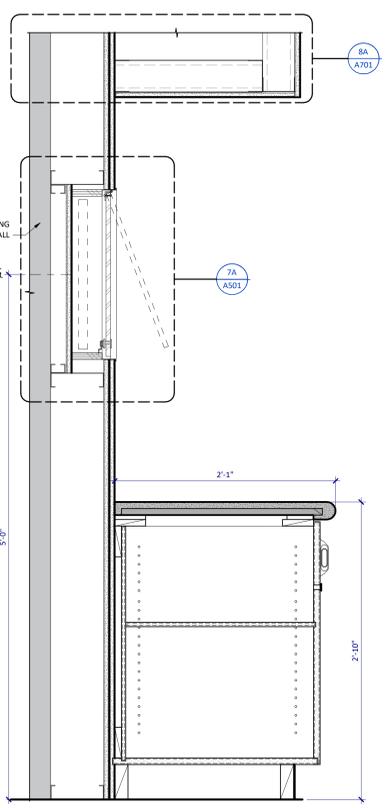

8A DINING/ACTIVITY ROOM TV ENCLOSURE DETAIL
 SCALE: 1 1/2" = 1'-0"

2/20/2026 2:59:46 PM

CHI ST. ALEXIUS HEALTH - WILLISTON
CHI MENTAL HEALTH REMODEL
 WILLISTON, ND

DATE	01/19/2026
PHASE	CONSTRUCTION DOCUMENTS
PROJECT	17153
SHEET	A501
INTERIOR DETAILS	

SHEET SPEC ID LIST


SPEC ID	SPEC SECTION & DESCRIPTION
BKE-1	10 5617 - WALL BRACKET
DPNL-1	06 4100 - PLAM ON MDF SUBSTRATE
GUN LOCKER-1	10 5113 - GUN LOCKER
MOP-1	10 2800 - UTILITY SHELF AND MOP HOLDER
MRRKB-1	10 1100 - MARKER BOARD
PT-1	09 9123 - PAINT
PT-2	09 9123 - PAINT
PT-6	09 9123 - PAINT
PTD-1	10 2800 - PAPER TOWEL DISPENSER, C-FOLD
RB-2	09 6500 - RESILIENT BASE
SP-1	10 2800 - SOAP DISPENSER, WALL MOUNT
SPTD-1	10 2800 - PSYCHIATRIC PAPER TOWEL DISPENSER, ROLL TYPE
SSM-1	12 3600 - SOLID SURFACE COUNTERTOP
SSM-3	12 3600 - SOLID SURFACE COUNTERTOP
SSP-1	10 2800 - PSYCHIATRIC SOAP DISPENSER, WALL MOUNT
T-2	09 3000 - TILE
VSF-4	09 6500 - SHEET VINYL FLOORING
WP-1	10 2600 - WALL PROTECTION PANEL
WP-2	10 2600 - WALL PROTECTION PANEL
WP-3	10 2600 - WALL PROTECTION PANEL

KEYNOTES - INTERIOR ELEV.


NO.	NOTE	REV.
01	EXISTING WINDOW TO REMAIN.	
02	GRAIN PATTERN OF PLAM SHALL RUN VERTICALLY TO MATCH CABINET DOORS. PROVIDE FLUSH SEAMS AS REQUIRED IN PANELS.	

GENERAL NOTES - INTERIOR ELEVATIONS


- A. REFER TO A620 FOR STANDARD CASEWORK ELEVATIONS AND CONSTRUCTION.
 - B. ALL WALL SURFACES TO BE (PT-1) UNLESS NOTED OTHERWISE.
 - C. PROVIDE LEVEL 5' DRYWALL FINISH AT ALL APPLIED GRAPHICS AND WRITABLE WALL SURFACE LOCATIONS.
 - D. PROVIDE WALL REINFORCEMENT AT ALL WALL MOUNTED ITEMS.
 - E. ANY EXPOSED CABINET EDGE SHALL BE FINISHED EDGE TO MATCH ADJACENT CABINET FINISH.
 - F. SEE SHEET G120 FOR ALL TOILET RIM HEIGHTS AND ACCESSORY MOUNTING HEIGHTS.
- E1 - EQUIPMENT TAG - REFER TO SPECIALTY EQUIPMENT SCHEDULE ON SHEET A801 FOR SPECIFIC INFORMATION AND PROVIDER

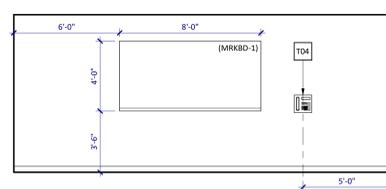


7C A611 GROUP ROOM - S ELEV.
 SCALE: 1/4" = 1'-0"




6C A611 HOUSEKEEPING - N ELEV.
 SCALE: 1/4" = 1'-0"




5C A611 HOUSEKEEPING - E ELEV.
 SCALE: 1/4" = 1'-0"




4C A611 WORK/COPY - E ELEV.
 SCALE: 1/4" = 1'-0"





7B A611 BENCH ALCOVE
 SCALE: 1/4" = 1'-0"




6B A611 SOILED WORK ROOM - W ELEV.
 SCALE: 1/4" = 1'-0"

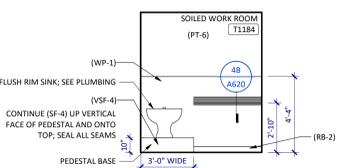


5B A611 SOILED WORK ROOM - S ELEV.
 SCALE: 1/4" = 1'-0"




3B A611 MED/VITALS - E ELEV.
 SCALE: 1/4" = 1'-0"

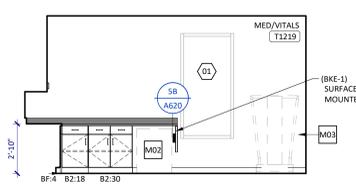


2B A611 MED/VITALS - S ELEV.
 SCALE: 1/4" = 1'-0"

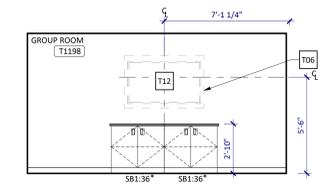


1B A611 INPATIENT GROUP ROOM - N ELEV.
 SCALE: 1/4" = 1'-0"

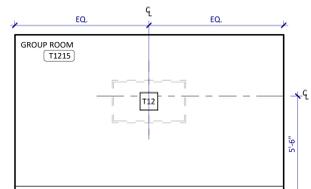


7A A611 OUTPATIENT GROUP ROOM - E ELEV.
 SCALE: 1/4" = 1'-0"




6A A611 PHONE ALCOVE - ELEV.
 SCALE: 1/4" = 1'-0"




5A A611 DINING/ACTIVITY - N ELEV.
 SCALE: 1/4" = 1'-0"

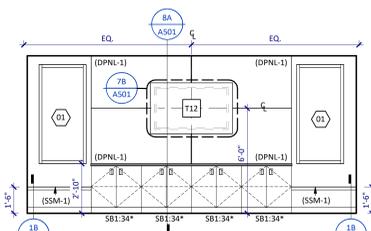


4A A611 DINING/ACTIVITY - WEST ELEVATION
 SCALE: 1/4" = 1'-0"



3A A611 TELEHEALTH - N ELEV.
 SCALE: 1/4" = 1'-0"

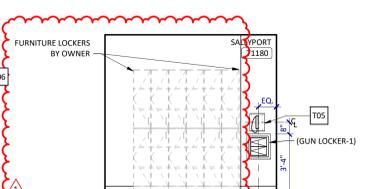

2A A611 LOCKERS - W ELEV.
 SCALE: 1/4" = 1'-0"



1A A611 WATER FOUNTAIN - S ELEV.
 SCALE: 1/4" = 1'-0"

KEYNOTES - CEILING PLAN		
NO.	NOTE	REV.
01	PROVIDE HOLD DOWN CLIPS AT THE CEILING TILE FOR THIS ROOM.	
02	REFER TO 6C/A701 FOR PT SHOWER LIGHT FIXTURE DIMENSIONS, ORIENTATION MAY BE ROTATED OR FLIPPED.	

JLG
architects



225 Broadway N, Suite 700
Fargo, ND 58102
phone (701) 364-0237
www.jlgarchitects.com
copyright © 2026

REGISTERED ARCHITECT
STATE OF NORTH DAKOTA
(2139)
3/19/2026


REVISION SCHEDULE		
NO.	DESCRIPTION	DATE
1	ADDENDUM #1	02/03/26

GENERAL NOTES - RCP


- COORDINATE FINAL SIZE AND FINAL LOCATION OF ALL ACCESS PANELS WITH TRADE REQUIRING SAME.
- COORDINATE CEILING SUSPENSION SYSTEMS WITH OTHER CEILING SPACE EQUIPMENT SUPPORTING DEVICES.
- FOR PARTITION TYPES, SEE SHEET A201.
- REFER TO LIFE SAFETY PLANS FOR LOCATIONS OF FIRE AND SMOKE RATED PARTITIONS.
- CEILING GRID SYSTEM TO BE CENTERED IN ROOM IN BOTH DIRECTIONS UNLESS NOTED OTHERWISE.
- NO CEILING PANEL TO BE CUT TO LESS THAN 6" WIDTH AT CEILING PANEL INSTALLATION TYPICAL.
- AT CONDITIONS WHERE CEILING TILE PADS EXCEED 2'-0" TRIM 2"x4" CEILING PADS AS REQUIRED TO FIT.
- SPRINKLER HEADS TO BE LOCATED IN THE CENTER OF CEILING PANELS TYPICALLY.
- VERIFY EXACT LOCATIONS OF SOFFIT AND CEILING CONTROL JOINTS WITH THE ARCHITECTS REPRESENTATIVE IN THE FIELD.
- COORDINATE THE LOCATION OF ESCUTCHEON PLATES AT CEILING PANEL PENETRATIONS WITH ELECTRICAL AND MECHANICAL TRADES.
- SEE ELECTRICAL DRAWINGS FOR FIXTURE TYPES AND NIGHT LIGHT LOCATIONS.
- PATCH AND REPAIR THE EXISTING CEILING PANELS AND GRID WHERE WALLS WERE REMOVED.
- CONTRACTOR SHALL MAINTAIN THE FIRE RATING INTEGRITY OF ALL EXISTING PARTITIONS INDICATED AS FIRE RESISTANCE RATED. ADVISE THE ARCHITECT OF ANY PRE-EXISTING BREACHES DISCOVERED IN THE COURSE OF WORK.

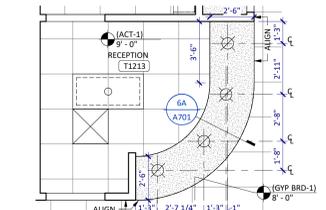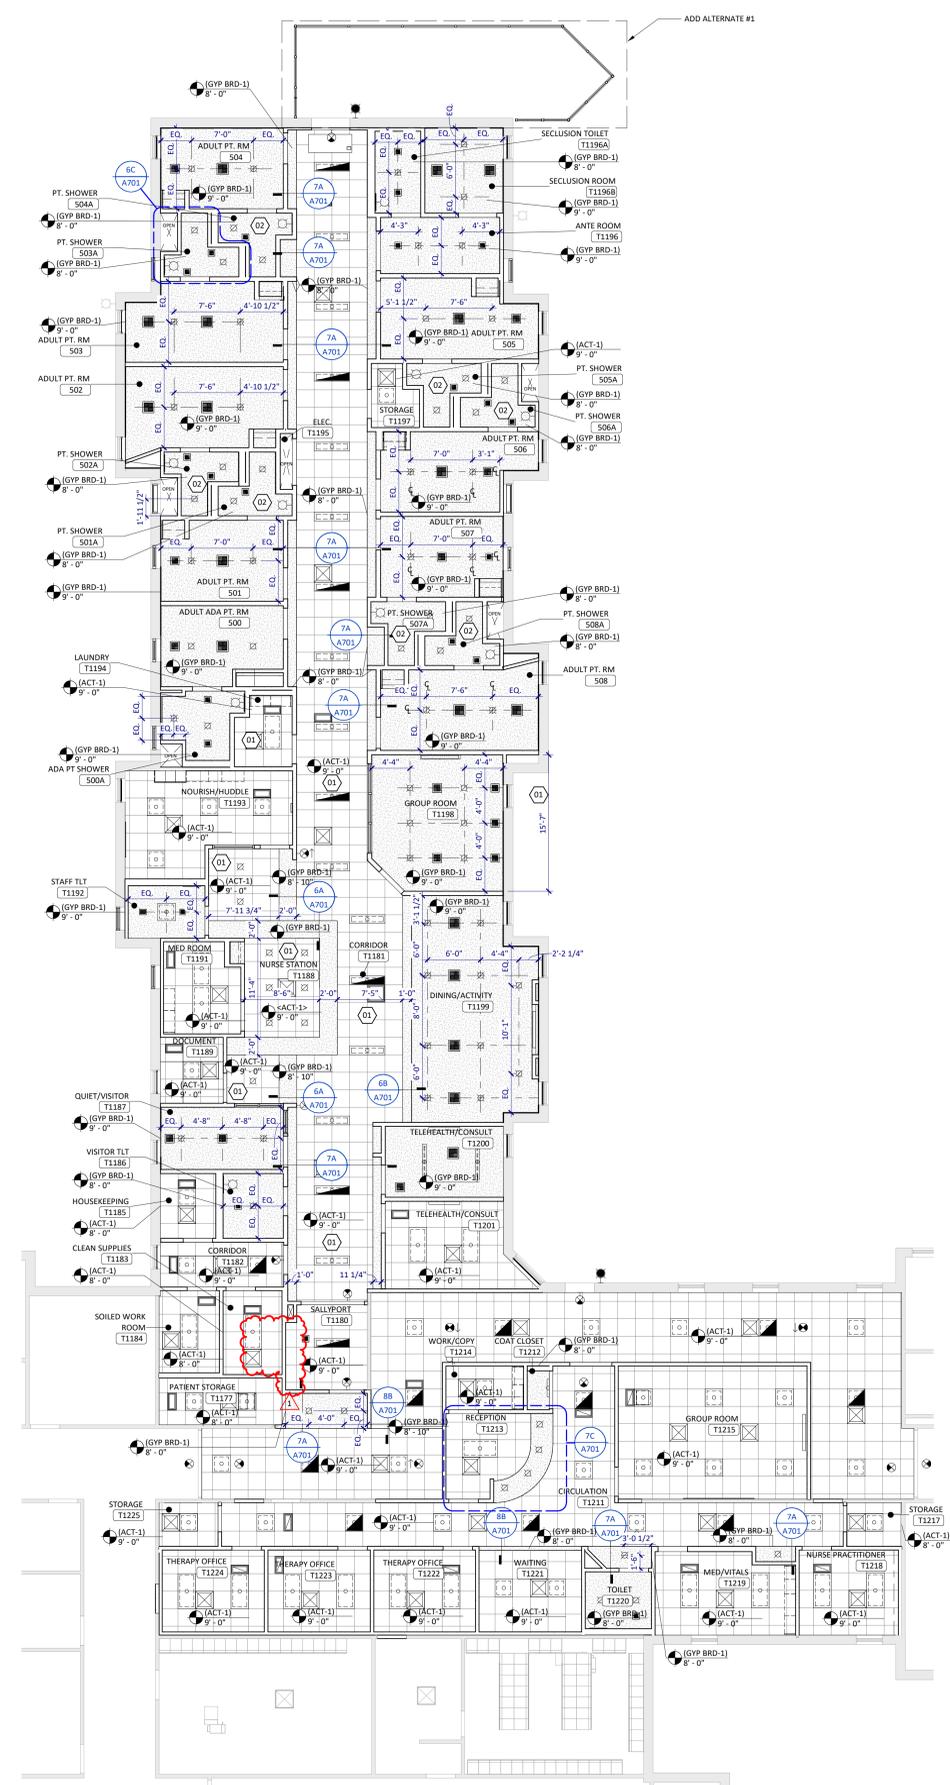


7C
A701 ENLARGED RCP - RECEPTION
SCALE: 1/4" = 1'-0"




6C
A701 ENLARGED RCP - PT SHOWER
SCALE: 1/4" = 1'-0"

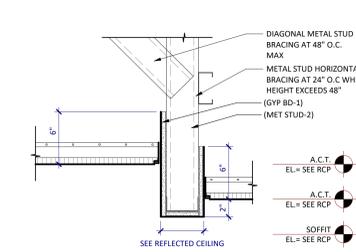


8B
A701 BULKHEAD/ACT CONNECTION
SCALE: 1 1/2" = 1'-0"

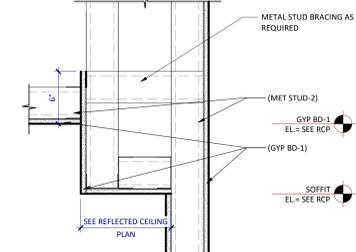


7B
A701 BULKHEAD/GYP SOFFIT WALL CONNECTION
SCALE: 1 1/2" = 1'-0"

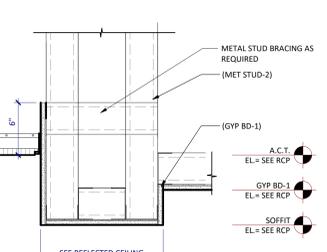


6B
A701 SOFFIT/ACT/GYP CONNECTION
SCALE: 1 1/2" = 1'-0"

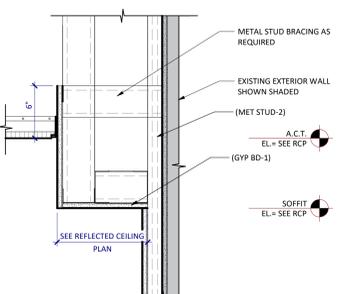

8A
A701 BULKHEAD/ACT SOFFIT WALL CONNECTION @ EXISTING WALL
SCALE: 1 1/2" = 1'-0"

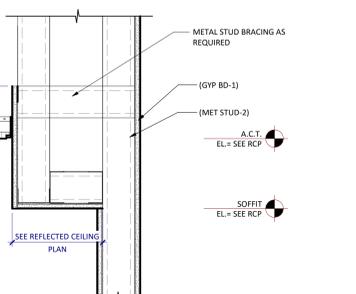


7A
A701 BULKHEAD/ACT SOFFIT WALL CONNECTION
SCALE: 1 1/2" = 1'-0"

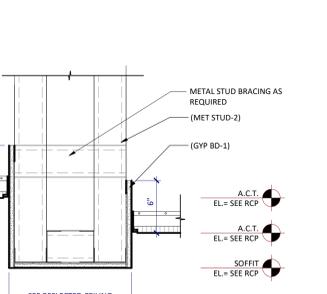

6A
A701 SOFFIT/ACT CONNECTION
SCALE: 1 1/2" = 1'-0"

4A
A701 PARTIAL FIRST LEVEL REFLECTED CEILING PLAN - ADULT PSYCHIATRIC UNIT AND OUTPATIENT SUITE
SCALE: 1/8" = 1'-0"

KEY AREA PLAN



CHI ST. ALEXIUS HEALTH - WILLISTON
CHI MENTAL HEALTH REMODEL
WILLISTON, ND


DATE
01/19/2026

PHASE
CONSTRUCTION DOCUMENTS


PROJECT
17153

SHEET
A701

FIRST FLOOR REFLECTED CEILING PLAN

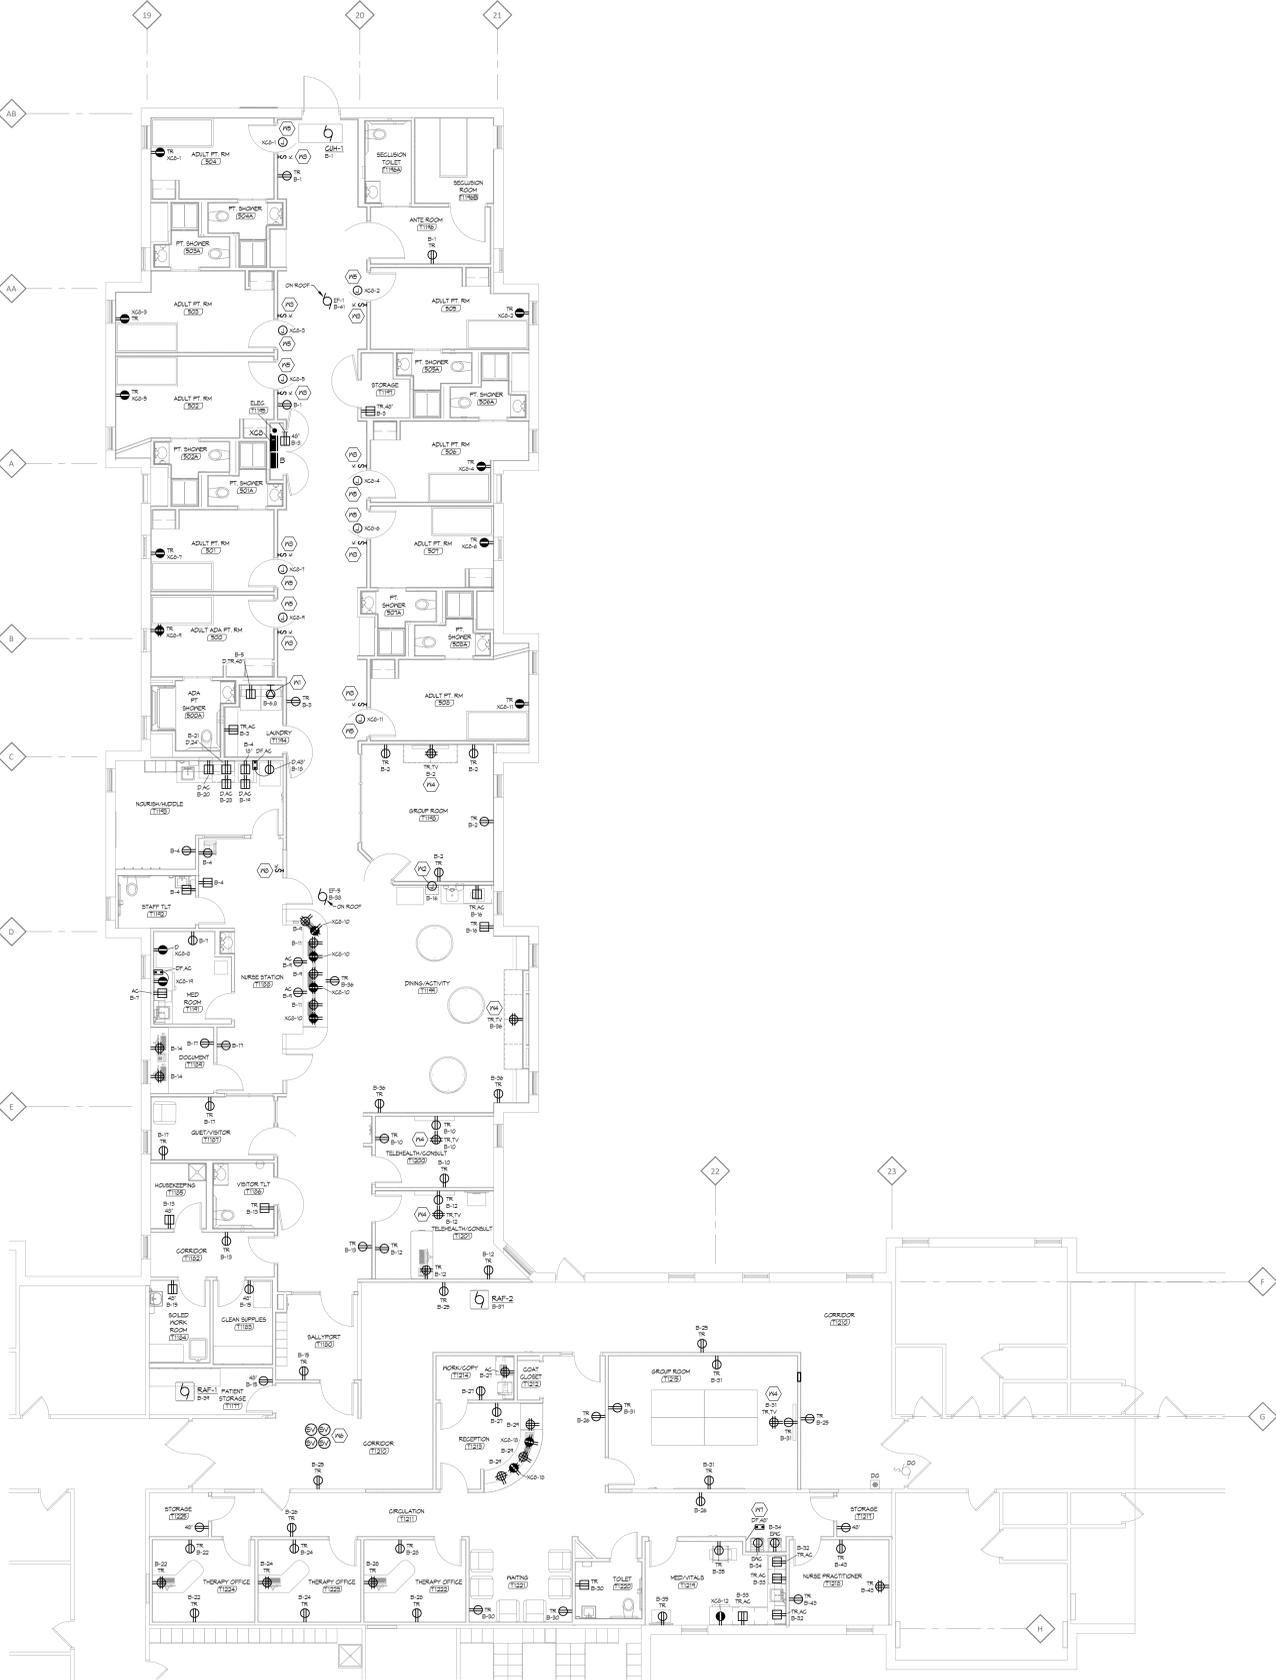

2 FIRST FLOOR PLAN - POWER
SCALE: 1/8" = 1'-0"

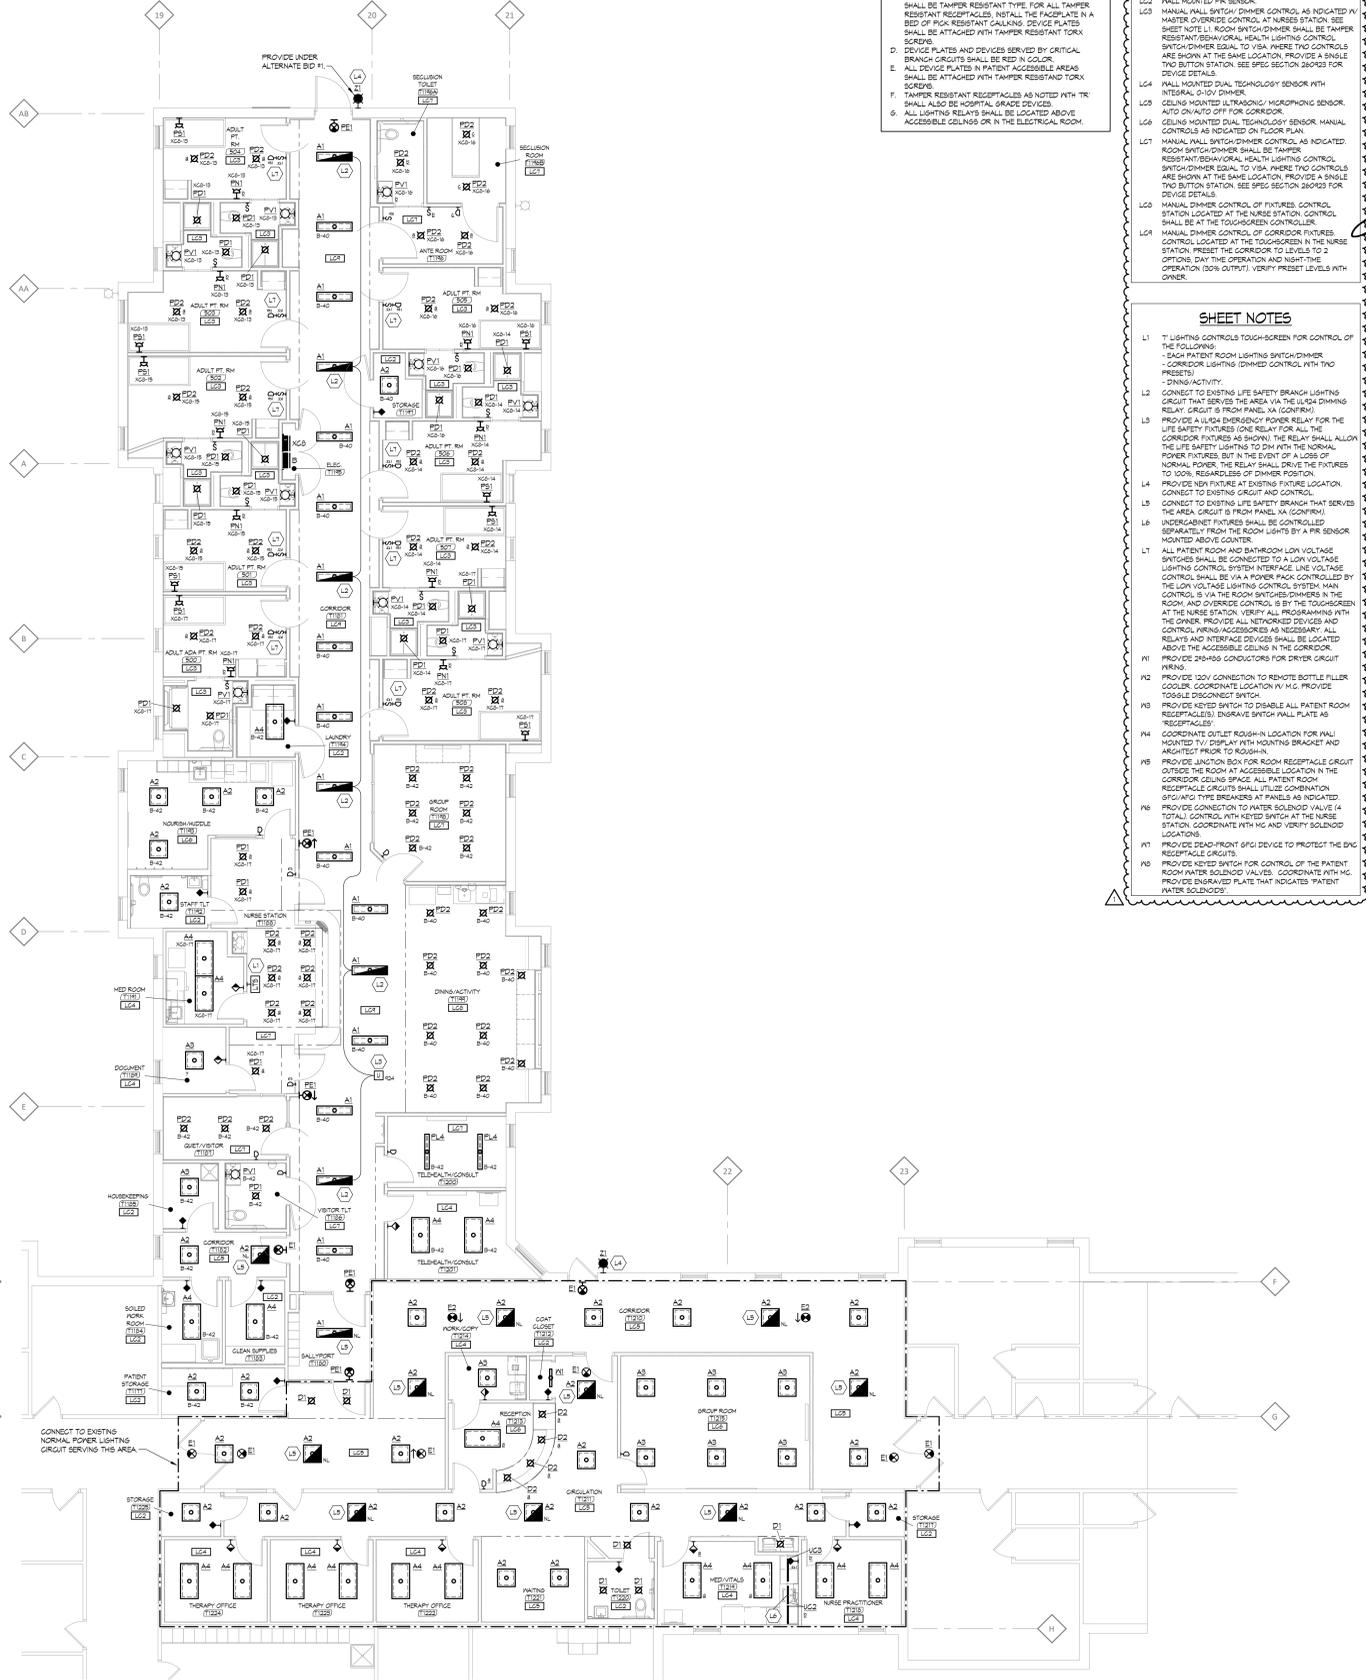

1 FIRST FLOOR PLAN - LIGHTING
SCALE: 1/8" = 1'-0"

GENERAL NOTES

- A. CONNECT FIXTURES NOTED ON LIFE SAFETY BRANCH AND ALL EXIT SIGNS TO THE EXISTING EMERGENCY LIGHTING CIRCUIT FROM PANEL 'A' THAT SERVES THE AREA.
- B. FIXTURES NOTED AS NIGHT-LIGHTS (NL) AND ALL EXIT SIGNS SHALL BE CONNECTED TO THE UNWITTED PHASE CONDUCTOR FOR 24/7 OPERATION.
- C. ALL NEW RECEPTABLES IN PATIENT ACCESSIBLE AREAS SHALL BE TAMPER RESISTANT TYPE FOR ALL TAMPER RESISTANT RECEPTABLES, INSTALL THE FACEPLATE IN A BED OF PPK RESISTANT CAULKING. DEVICE PLATES SHALL BE ATTACHED WITH TAMPER RESISTANT TORX SCREWS.
- D. DEVICE PLATES AND DEVICES SERVED BY CRITICAL BRANCH CIRCUITS SHALL BE RED IN COLOR.
- E. ALL DEVICE PLATES IN PATIENT ACCESSIBLE AREAS SHALL BE ATTACHED WITH TAMPER RESISTANT TORX SCREWS.
- F. TAMPER RESISTANT RECEPTABLES AS NOTED WITH 'TR' SHALL ALSO BE HOSPITAL GRADE DEVICES.
- G. ALL LIGHTING RELAYS SHALL BE LOCATED ABOVE ACCESSIBLE CEILING OR IN THE ELECTRICAL ROOM.

LIGHTING CONTROL NOTES:

- L22 WALL MOUNTED PIR SENSOR
- L23 MANUAL WALL SWITCH, DIMMER CONTROL, AS INDICATED IN MASTER OVERLAYS CONTROL, AT NURSE STATION. SEE SHEET NOTE 1. ROOM SWITCHES DIMMERS SHALL BE TAMPER RESISTANT/BEHAVIORAL HEALTH LIGHTING CONTROL. SWITCH DIMMER EQUAL TO USA. WHERE TWO CONTROLS ARE SHOWN AT THE SAME LOCATION, PROVIDE A SINGLE TWO BUTTON STATION. SEE SPEC SECTION 28093 FOR DEVICE DETAILS.
- L24 WALL MOUNTED DUAL TECHNOLOGY SENSOR WITH INTERNAL 0-10V DIMMER
- L25 CEILING MOUNTED ULTRASONIC/MICROPHONIC SENSOR. CONTROL AS NOTED ON FLOOR PLAN.
- L26 MANUAL WALL SWITCH/DIMMER CONTROL, AS INDICATED. ROOM SWITCH/DIMMER SHALL BE TAMPER RESISTANT/BEHAVIORAL HEALTH LIGHTING CONTROL. SWITCH/DIMMER EQUAL TO USA. WHERE TWO CONTROLS ARE SHOWN AT THE SAME LOCATION, PROVIDE A SINGLE TWO BUTTON STATION. SEE SPEC SECTION 28093 FOR DEVICE DETAILS.
- L27 MANUAL WALL SWITCH/DIMMER CONTROL, AS INDICATED. ROOM SWITCH/DIMMER SHALL BE TAMPER RESISTANT/BEHAVIORAL HEALTH LIGHTING CONTROL. SWITCH/DIMMER EQUAL TO USA. WHERE TWO CONTROLS ARE SHOWN AT THE SAME LOCATION, PROVIDE A SINGLE TWO BUTTON STATION. SEE SPEC SECTION 28093 FOR DEVICE DETAILS.
- L28 MANUAL DIMMER CONTROL OF FIXTURES. CONTROL STATION LOCATED AT THE NURSE STATION. CONTROL SHALL BE AT THE TOUCHSCREEN CONTROLLER.
- L29 MANUAL DIMMER CONTROL OF CORRIDOR FIXTURES. CONTROL LOCATED AT THE TOUCHSCREEN IN THE NURSE STATION. PRESET THE CORRIDOR TO LEVELS TO 2 OPTIONS. DAY OPERATION AND NIGHT-TIME OPERATION. (ON/OFF). VERIFY PRESET LEVELS WITH OWNER.

SHEET NOTES

- L1 LIGHTING CONTROLS TOUCH-SCREEN FOR CONTROL OF THE FOLLOWING:
 - EACH PATIENT ROOM LIGHTING SWITCH/DIMMER
 - CORRIDOR LIGHTING DIMMER CONTROL WITH TWO PRESETS
- L2 CONNECT TO EXISTING LIFE SAFETY BRANCH LIGHTING CIRCUIT THAT SERVES THE AREA VIA THE ULTRA DIMMING RELAY. CIRCUIT IS FROM PANEL 'A' (CONFORM).
- L3 PROVIDE A ULTRA EMERGENCY POWER RELAY FOR THE LIFE SAFETY FIXTURES (ONE RELAY FOR ALL THE CORRIDOR FIXTURES AS SHOWN). THE RELAY SHALL ALLOW THE LIFE SAFETY LIGHTS TO DIM WITH THE NORMAL POWER FIXTURES, BUT IN THE EVENT OF A LOSS OF NORMAL POWER, THE RELAY SHALL DRIVE THE FIXTURES TO 100% REGARDLESS OF DIMMER POSITION.
- L4 PROVIDE NEW FIXTURE AT EXISTING FIXTURE LOCATION. CONNECT TO EXISTING CIRCUIT AND CONTROL.
- L5 CONNECT TO EXISTING LIFE SAFETY BRANCH THAT SERVES THE AREA. CIRCUIT IS FROM PANEL 'A' (CONFORM).
- L6 UNDERCABINET FIXTURES SHALL BE CONTROLLED SEPARATELY FROM THE ROOM LIGHTS BY A PIR SENSOR MOUNTED ABOVE COUNTER.
- L7 ALL PATIENT ROOM AND BATHROOM LOW VOLTAGE SWITCHES SHALL BE CONNECTED TO A LOW VOLTAGE LIGHTING CONTROL SYSTEM INTERFACE LINE VOLTAGE CONTROL SHALL BE VIA A POWER PACK CONTROLLED BY THE LOW VOLTAGE LIGHTING CONTROL SYSTEM. MAIN CONTROL IS VIA THE ROOM SWITCHES DIMMERS IN THE ROOM. AND OVERRIDE CONTROL IS BY THE TOUCHSCREEN AT THE NURSE STATION. VERIFY ALL PROGRAMMING WITH THE OWNER. PROVIDE ALL NETWORKED DEVICES AND CONTROL WIRING/ACCESSORIES AS NECESSARY. ALL RELAYS AND INTERFACE DEVICES SHALL BE LOCATED ABOVE THE ACCESSIBLE CEILING IN THE CORRIDOR.
- L8 PROVIDE 2#14-3 CONDUCTORS FOR DRYER CIRCUIT WIRING.
- L9 PROVIDE 100V CONNECTION TO REMOTE BOTTLE FILLER. COORDINATE LOCATION WITH HIG. PROVIDE TOGGLE DISCONNECT SWITCH.
- L10 PROVIDE KEYSWITCH TO DISABLE ALL PATIENT ROOM RECEPTABLES. ENGRAVE SWITCH PLATE AS 'RECEPTABLES'.
- L11 COORDINATE OUTLET POSITION LOCATION FOR WALL MOUNTED TV. DISPLAY WITH MOUNTING BRACKET AND ACQUAINT PRIOR TO ROOMWORK.
- L12 PROVIDE JUNCTION BOX FOR ROOM RECEPTACLE CIRCUIT OUTSIDE THE ROOM AT ACCESSIBLE LOCATION IN THE CORRIDOR. CEILING SPACE. ALL PATIENT ROOM RECEPTACLE CIRCUITS SHALL UTILIZE COMBINATION SPECIALTY TYPE BREAKERS AS INDICATED.
- L13 PROVIDE CONNECTION TO WATER SOLVED VALVE (4 TOTAL). CONTROL WITH KEYSWITCH AT THE NURSE STATION. COORDINATE WITH HIG AND VERIFY SOLVED VALVE LOCATION.
- L14 PROVIDE DEAD-FRONT SPG DEVICE TO PROTECT THE DPC RECEPTACLE CIRCUITS.
- L15 PROVIDE KEYSWITCH FOR CONTROL OF THE PATIENT ROOM WATER SOLVED VALVES. COORDINATE WITH HIG. PROVIDE ENGRAVED PLATE THAT INDICATES 'PATIENT WATER SOLVED VALVE'.

JLG architects

235 Broadway N, Suite 700
Fargo, ND 58102
phone (701) 364-0377
www.jlgarchitects.com
copyright © 2025

CMTA
A LEEDIFICE Company
cmta.com | 877.380.0501

PROFESSIONAL SEAL
ANTHONY J. NELSON
PE - 0251
DATE 1/19/2026
NORTH DAKOTA

REVISION SCHEDULE

NO.	DESCRIPTION	DATE
1	Addendum #1	2/3/2026

CHI ST. ALEXIUS HEALTH - WILLISTON
CHI MENTAL HEALTH REMODEL
WILLISTON, ND

DATE
01/19/2026

PHASE
CONSTRUCTION DOCUMENTS

PROJECT
2024247

SHEET
E201

FIRST FLOOR PLAN - LIGHTING & POWER


2/20/2026 1:41:30 PM

LIGHT FIXTURE SCHEDULE


- GENERAL NOTES:**
 A. SEE SPEC SECTION 26 0000 AND 28 5100 FOR ADDITIONAL REQUIREMENTS AS REQUIRED.
 B. EQUAL TO AND OR EQUAL WHERE MATERIALS ARE SPECIFICALLY IDENTIFIED WITH EQUAL TO / OR EQUAL. SUBSTITUTE MANUFACTURERS COMPLYING WITH THE REQUIREMENTS OF THESE SPECIFICATIONS BUT NOT LISTED MAY BE INCORPORATED IN THE WORK, SUCH MATERIALS EQUAL TO OR SUPERIOR, IN ENGINEER'S OPINION, TO THAT SPECIFIED IN CONSTRUCTION, EFFICIENCY, APPEARANCE, AND UTILITY.
 C. ALL DIMENSIONS ARE NOMINAL UNLESS NOTED OTHERWISE.
 D. RATED LIFE OF LED LUMINAIRES SHALL BE 50,000 HOURS UNLESS OTHERWISE NOTED.
 E. EMERGENCY LUMINAIRES SHALL BE EQUIPPED WITH SELF-DIAGNOSTIC BATTERIES UNLESS OTHERWISE NOTED.
 F. COLOR TEMPERATURE OF LED LUMINAIRES IS NOMINAL UNLESS OTHERWISE NOTED.
 G. SYSTEM WATTAGE SCHEDULED IS NOMINAL UNLESS NOTED OTHERWISE.
 H. 0-10V LED DRIVERS TO BE FURNISHED WITH ISOLATED GRONDING. COMMON WIRE SHALL BE ISOLATED FROM THE POWER SYSTEM GROUND WIRE OF THE POWER SUPPLY.
 I. DIMMING COMPONENTS SHALL BE COMPATIBLE WITH SPECIFIED LIGHTING CONTROL SYSTEMS.
 J. LINEAR LUMINAIRE LENGTHS GREATER THAN 8'-0" LENS & REFLECTOR SHALL BE CONTINUOUS FROM END TO END (WITHOUT VISIBLE JOINTS) FOR THE TOTAL RUN LENGTH.
 K. REFER TO ARCHITECTURAL, LANDSCAPING, AND CIVIL PLANS FOR COORDINATION AND ADDITIONAL INFORMATION, DETAILS, MOUNTING, AND LOCATION OF EQUIPMENT.
 L. PROVIDE T-GRID MOUNTING HARDWARE WHERE REQUIRED. REFER TO ARCHITECTURAL RCP PLANS FOR MORE INFORMATION.

NOTES:
 1. ALLOWANCE COST LISTED IS THE DISTRIBUTOR NET PRICE FOR EACH FIXTURE. CONTRACTOR AND DISTRIBUTOR SHALL ADD COST FOR FREIGHT AND MARKUP AS APPROPRIATE. CONTRACTOR SHALL ADD ALL COSTS FOR INSTALLATION.

TYPE	MANUFACTURER	SERIES	VOLT	CCT	CRI	LUMENS	POWER SUPPLY/DIMMING		DIMENSIONS	MOUNTING	FINISH	DESCRIPTION	
							WATTAGE	DIMMING					
A1	EQUAL TO METALUX	147PK	MYVOLT	4000K	90	3000	25 W	0-10V DIM	2.25" DEPTH 2 X 2	RECESSED T-GRID	WHITE	BACK LIT FLAT PANEL, RIGID HOUSING DIE-FORMED STEEL FRAME CONSTRUCTION. BATH WHITE LENS, NO VISIBLE LED DOZES.	
A2	EQUAL TO METALUX	227PK	MYVOLT	4000K	90	3300	30 W	0-10V DIM	2.25" DEPTH 2 X 2	RECESSED T-GRID	WHITE	BACK LIT FLAT PANEL, RIGID HOUSING DIE-FORMED STEEL FRAME CONSTRUCTION. BATH WHITE LENS, NO VISIBLE LED DOZES. PROVIDE PLANGE KITS AS NEEDED.	
A3	EQUAL TO METALUX	227PK	MYVOLT	4000K	90	4465	34 W	0-10V DIM	2.25" DEPTH 2 X 2	RECESSED T-GRID	WHITE	SAME AS A2 EXCEPT LIGHT SOURCE INFORMATION.	
A4	EQUAL TO METALUX	247PK	MYVOLT	4000K	90	8400	0 W	0-10V DIM	2.25" DEPTH 2 X 4	RECESSED T-GRID	WHITE	BACK LIT FLAT PANEL, RIGID HOUSING DIE-FORMED STEEL FRAME CONSTRUCTION. BATH WHITE LENS, NO VISIBLE LED DOZES.	
D1	EQUAL TO ATLANTIC PORTFOLIO HALO	BYV LED4 LQ40 H24	MYVOLT	4000K	90	1000	10 W	0-10V DIM	4" H 4" DIA	TO BE SELECTED BY ARCH	WHITE	SELF-FLANGED DOWNLIGHT, ALUM. LOWER REFLECTOR RETAINED IN (2) TORSION SPRINGS IN COMBINATION W/ LENSED UPPER REFLECTOR. UNIVERSAL MOUNTING BRACKET, EXTRUDED ALUM. HEAT SINK. DAMP LOCATION RATED. (50 DSB BEAM) MEDIUM DISTRIBUTION. DRIVER ACCESSIBLE FROM BELOW CEILING.	
D2	EQUAL TO ATLANTIC PORTFOLIO HALO	BYV LED4 LQ40 H24	MYVOLT	4000K	90	2000	20 W	0-10V DIM	4" H 4" DIA	TO BE SELECTED BY ARCH	WHITE	SELF-FLANGED DOWNLIGHT, ALUM. LOWER REFLECTOR RETAINED IN (2) TORSION SPRINGS IN COMBINATION W/ LENSED UPPER REFLECTOR. UNIVERSAL MOUNTING BRACKET, EXTRUDED ALUM. HEAT SINK. DAMP LOCATION RATED. (50 DSB BEAM) MEDIUM DISTRIBUTION. DRIVER ACCESSIBLE FROM BELOW CEILING.	
E1	EQUAL TO SUR-LITES	LFX	MYVOLT	MS	MS	MS	2.5 W	—	—	STANDARD	UNIVERSAL	WHITE	SINGLE FACE THERMOPLASTIC / POLYCARBONATE EXIT SIGN. SINGLE FACE WITH RED OPTICAL DRIVER.
E2	EQUAL TO SUR-LITES	LFX	MYVOLT	MS	MS	MS	2.5 W	—	—	STANDARD	CEILING	WHITE	SAME AS E1 EXCEPT DOUBLE FACED.
PD1	EQUAL TO KURLIN	URG-04VND	MYVOLT	4000K	90	1000	11 W	0-10V DIM	4" D APERTURE 6-11/16" H	RECESSED 6"FP	TO BE SELECTED BY ARCH	BEHAVIOR HEALTH LED DOWNLIGHT, CLEAR TEMPERED GLASS UPPER LENS, 1/4" CLEAR POLYCARBONATE FLUSH LENS. CONTINUAL SEAL BETWEEN LENS AND TRIM, TAMPER RESISTANT FLUSH STEEL TRIM WITH ANTI-MICROBIAL FINISH. TORX CENTER PIN. VANDAL RESISTANT SCREWS. DIE-CAST ALUMINUM HEAT SINK. LIGHTSURE RESISTANT CONSTRUCTION, MED DISTRIBUTION, GUARANTEE AGAINST BREAKAGE WARRANTY.	
PD2	EQUAL TO KURLIN	URG-04VND	MYVOLT	4000K	90	2000	25 W	0-10V DIM	4" D APERTURE 6-11/16" H	RECESSED 6"FP	TO BE SELECTED BY ARCH	BEHAVIOR HEALTH LED DOWNLIGHT, CLEAR TEMPERED GLASS UPPER LENS, 1/4" CLEAR POLYCARBONATE FLUSH LENS. CONTINUAL SEAL BETWEEN LENS AND TRIM, TAMPER RESISTANT FLUSH STEEL TRIM WITH ANTI-MICROBIAL FINISH. TORX CENTER PIN. VANDAL RESISTANT SCREWS. DIE-CAST ALUMINUM HEAT SINK. LIGHTSURE RESISTANT CONSTRUCTION, MED DISTRIBUTION, GUARANTEE AGAINST BREAKAGE WARRANTY.	
PE1	EQUAL TO LITHONIA	LV	MYVOLT	MS	MS	MS	2.5 W	—	—	STANDARD	SURFACE WALL	TO BE SELECTED BY ARCH	MINIMUM SECURITY SURFACE. SINGLE FACE LED EXIT LIGHT. DIE-CAST ALUMINUM HOUSING AND RED LETTERS.
PL4	EQUAL TO BELUX	M4L20R1	MYVOLT	4000K	90	6176	74 W	—	—	—	—	TO BE SELECTED BY ARCH	BEHAVIORAL HEALTH, RECESSED LINEAR SLOT, EXTRUDED ALUMINUM FRAME, LIGHTSURE RESISTANT HOUSING INTEGRATED WITH CEILING SYSTEM. LENS SHIELDING TO BE 3MM CLEAR POLYCARBONATE PRISMATIC LENS. K10 IMPACT RATED LENS, TAMPER RESISTANT FRAME, PIN-IN-TORX SCREWS, HOUSING FULLY SEALED FROM ROOM SIDE.
PN1	EQUAL TO AMIGO LIGHTING	L-LIN-62	MYVOLT	4000K	90	35	4 W	—	2.25" DEPTH 5"X5"	WALL MTD 1'-6" AFF	TO BE SELECTED BY ARCH	BEHAVIORAL HEALTH LED NIGHTLIGHT, TRANSLUCENT AMBER POLYCARBONATE LENS, SHARDED ALUMINUM TRIM, LIGHTSURE RESISTANT CONSTRUCTION, TORX CENTER-REJECTION PIN SCREWS.	
PS1	APPROVED EQUAL TO (NOTE 2) ALLOWANCE PRICED AT \$800	GE3000-616	MYVOLT	3500K	90	300	8 W	0-10V DIMMING	3-3/4" W 6-5/4" H 3" D (ACA)	SURFACE WALL	TO BE SELECTED BY ARCH	IMPACT RESISTANT WALL SOURCE, CAST ALUMINUM HOUSING, 1/4" IMPACT RESISTANT POLYCARBONATE LENS, 2" DISTRIBUTION (NARROW), TAMPER RESISTANT SCREWS (PIN-IN-TORX), INTERNAL DRIVER, 2" (NARROW) DISTRIBUTION, LIGHTSURE RESISTANT, BEHAVIORAL HEALTH INSTALLATION.	
PF1	APPROVED EQUAL TO	GE344-14	MYVOLT	4000K	90	1800	10 W	—	14-3/4" W 2-1/2" H 2-1/2" D	VANITY WALL	TO BE SELECTED BY ARCH	ABOVE MIRROR VANITY, DIE-CAST ALUMINUM HOUSING, MOUNT DOWNLIGHT ORIENTATION, INTERNAL DRIVER, HIGH ABUSE BEHAVIOR HEALTH INSTALLATION.	
UC2	APPROVED EQUAL TO OSIL LIGHTING CONTECA LITHONIA HALO	COUNTERATTACK LED LFI2 LFI1 H21	MYVOLT	4000K	90	700	10 W	—	1" H 3.25" W 24" L	SURFACE UNDER CABINET	TO BE SELECTED BY ARCH	LOW PROFILE UNDER CABINET LED, HEAVY GAUGE ALUMINUM HOUSING WITH COLOR MATCH END CAPS/ACCESSORIES, FLOKOR AND NOISE FREE OPERATION, PROVIDE EASY GAIN CONNECTIONS.	
UC3	APPROVED EQUAL TO OSIL LIGHTING CONTECA LITHONIA HALO	COUNTERATTACK LED LFI2 LFI1 H21	MYVOLT	4000K	90	1000	15 W	—	1" H 3.25" W 24" L	SURFACE UNDER CABINET	TO BE SELECTED BY ARCH	LOW PROFILE UNDER CABINET LED, HEAVY GAUGE ALUMINUM HOUSING WITH COLOR MATCH END CAPS/ACCESSORIES, FLOKOR AND NOISE FREE OPERATION, PROVIDE EASY GAIN CONNECTIONS.	
W1	EQUAL TO METALUX	BT1	MYVOLT	4000K	90	2200	20 W	—	2-1/2" D	WALL	WHITE	LED STRIP LIGHT.	
Z1	EQUAL TO LITHONIA	PD662	MYVOLT	NOTE 1	90	4500	0 W	—	1" D 11.5" W 4" H	EXTERIOR WALL	TO BE SELECTED BY ARCH	LED NET LISTED WALL MOUNTED FIXTURE, INCE FORWARD THRU DISTRIBUTION.	

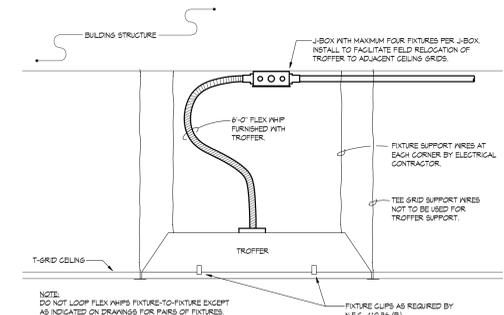

2 TYPICAL GRID TROFFER INSTALLATION DETAIL
SCALE: NTS

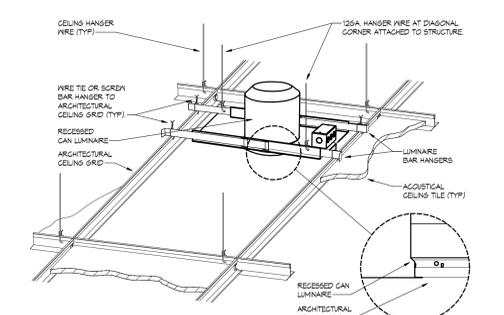

1 TYPICAL GRID RECESSED CAN INSTALLATION DETAIL
SCALE: NTS

REVISION SCHEDULE

NO.	DESCRIPTION	DATE
1	Addendum #1	2/3/2026