

SECTION 00 9113.01 - ADDENDUM #1

1.1 PROJECT INFORMATION

- A. Project Name: **North Central State Office Building.**
- B. Owner: **ND Office of Management & Budget.**
- C. Architect: **Ackerman-Estvold, Engineering & Management Consulting, Inc.**
- D. Architect Project Number: **R25110.**
- E. Date of Addendum: **03/04/2026.**

1.2 NOTICE TO BIDDERS

- A. This Addendum is issued pursuant to the Instructions to Bidders and Conditions of the Contract. This Addendum serves to clarify, revise, and supersede information in the Project Manual, Drawings, and previously issued Addenda. Portions of the Addendum affecting the Contract Documents will be incorporated into the Contract by enumeration of the Addendum in the Owner/Contractor Agreement.
- B. The Bidder shall acknowledge receipt of this Addendum in the appropriate space on the Bid Form.
- C. The date for receipt of bids is unchanged by this Addendum, at same time and location.
 - 1. Bid Date: Tuesday, March 24th 2026 @ 2:00 pm local time.

1.3 CLARIFICATIONS

- A. Title Block: Line Of Text Below the "North Central State Office Building" text line should read "ND Office of Management & Budget" in lieu of "SA". This is typical at all architectural sheet.

1.4 ATTACHMENTS

- A. This Addendum includes no attachments.
- B. This Addendum includes the following attached Documents and Specification Sections:
 - 1. Electrical Addendum E1, dated 03/04/2026, (new).
- C. This Addendum includes the following attached Sheets:
 - 1. Architectural Sheet A201, dated 02/20/2026, (reissued).

2. Architectural Sheet A600, dated 02/20/2026, (reissued).

1.5 REVISIONS TO DIVISIONS 02 - 49 SPECIFICATION SECTIONS

- A. Specification Section 13 3419 Metal Building Systems, (not reissued).
 1. Paragraph 2.1: Add line B to read "Requests for substitutions will be considered during the bid in accordance with provisions of Section 00 2600 "Procurement Substitutions."
 2. Paragraph 2.4 A. 3.: Revise to read "Joint Type: Mechanically Seamed" in lieu of "Joint Type: Panels snapped together".
 3. Paragraph 3.3 B.: Omit subpart 3. In its entirety.

1.6 REVISIONS TO DRAWING SHEETS

- A. All Architectural sheets (not reissued).
 1. Title Block: Line Of Text Below the "North Central State Office Building" text line should read "ND Office of Management & Budget" in lieu of "SA". This is typical at all architectural sheet.
- B. Sheet A201 – Exterior Elevations (reissued).
 1. Drawing 4/A201: Revised height of door 134-8 to be 12'-0" in lieu of 10'-0".
- C. Sheet A600 - Door & Window Schedules & Types (reissued).
 1. Window Types: Revise notes below W1 & W2 windows to read "Thermally Broken Window..." in lieu of "Aluminum Window..."
 2. Door Schedule: Revised detail number callouts for all head and jamb details.
 3. Door Schedule: Added frame types for Aluminum framed entrance doors (101-1, 101-2, 133-1, 133-2, & 147-1).
 4. Door Schedule: Revised height of door 134-8 to be 12'-0" in lieu of 10'-0".
- D. Sheet A610 – Aluminum Schedule & Types (not reissued).
 1. Drawing 8/A610: Revised to show Aluminum Storefront Entrance Lock Stile in lieu of the Aluminum Storefront Entrance Hinge Stile.
 2. Drawing 9/A610: Revised to show Aluminum Storefront Entrance Lock Stile in lieu of the Aluminum Storefront Entrance Hinge Stile.

1.7 PROCUREMENT SUBSTITUTION APPROVALS

- A. Subject to compliance with requirements of the specifications, the following are approved substitutions:

Specification Section	Basis of Design / Product	Approved Substitution
13 3419 Metal Building Systems	See Specification.	Butler Manufacturing.

END OF DOCUMENT 00 9113.01

ELECTRICAL ADDENDUM #E1

03/04/2026

North Central State Office Building
Minot, North Dakota
25048

PRAIRIE ENGINEERING, P.C.
1905 17TH ST SE
MINOT, NORTH DAKOTA

THIS ADDENDUM SHALL BECOME A PART OF THE PLANS AND SPECIFICATIONS AND ITS RECEIPT SHALL BE NOTED ON THE BID FORM.

ATTACHMENTS: This Addendum includes the following attached Drawings:

1. E001

DRAWING ITEM #1. Detail 1/E001

- A. Updated the background to match the civil drawings.

DRAWING ITEM #2. Detail 3/E001

- A. Added detail in its entirety.

SPECIFICATION ITEM #1. Section 263213

- A. Remove Item F.2 from Part 2.1 as there is no deduct alternate.

CONTINGENT UPON MEETING ALL SPECIFICATIONS, FOLLOWING ITEMS ARE ACCEPTABLE FOR BIDDING:

<u>Type</u>	<u>Manufacturer</u>	<u>Catalog Number</u>
G1	Gotham	EVO4SH series
K1	ALS Lighting	WAA-100 series
V1	Lithonia	VCPG series


ELEVATION GENERAL NOTES

©2024 by Ackerman-Estvold. These drawings, including all design, detail, specifications, and information, are the sole copyright of Ackerman-Estvold and are for use on this specific project only. These drawings shall not be used on any other work without written consent and agreement of Ackerman-Estvold.


I hereby certify that this plan specification, or report was prepared by me or under my direct supervision, and that I am a duly Registered Architect under the laws of the State of North Dakota.

[Signature]
Date: 2/20/26 Ref. No. 1774


- COORDINATE COLORS OF ALL METAL WALL PANELS, METAL ROOFING PANELS, TRIMS, FASCIAS, GUTTERS, DOWNSPOUTS, FLASHINGS, FASTENERS, AND OTHER ASSOCIATED EXPOSED FINISHES WITH ARCHITECT.
- PAINT ALL EXPOSED STEEL STRUCTURE, COORDINATE COLORS WITH ARCHITECT. MECHANICAL DUCTS SHALL BE INSULATED AND FIELD PAINTED WITH COLOR SELECTED BY ARCHITECT. MECHANICAL LOUVERS SHALL BE FIELD PAINTED BY ARCHITECT.
- PENETRATIONS THROUGH EXTERIOR WALL FINISHES SHALL BE FINISHED WITH THE SAME ADJACENT MATERIALS AND TRIMS AS THE ADJACENT FINISHES. COLORS SHALL BE SELECTED BY THE ARCHITECT.
- ALL PENETRATIONS THROUGH EXTERIOR WALLS SHALL HAVE THE ANNULAR SPACE AROUND THE PENETRATION FILLED WITH MINERAL WOOL AND SEALED WITH CONTINUOUS BACKER AND SEALANTS. COLOR COORDINATED TRIM SHALL BE PROVIDED & INSTALLED AT THE PERIMETER OF THE PENETRATION ON EITHER SIDE OF THE WALL UNO, COLORS SELECTED BY ARCHITECT.
- PROVIDE PRECAST CONCRETE SPLASH BLOCKS @ ALL DOWNSPOUT LOCATIONS, TYP.

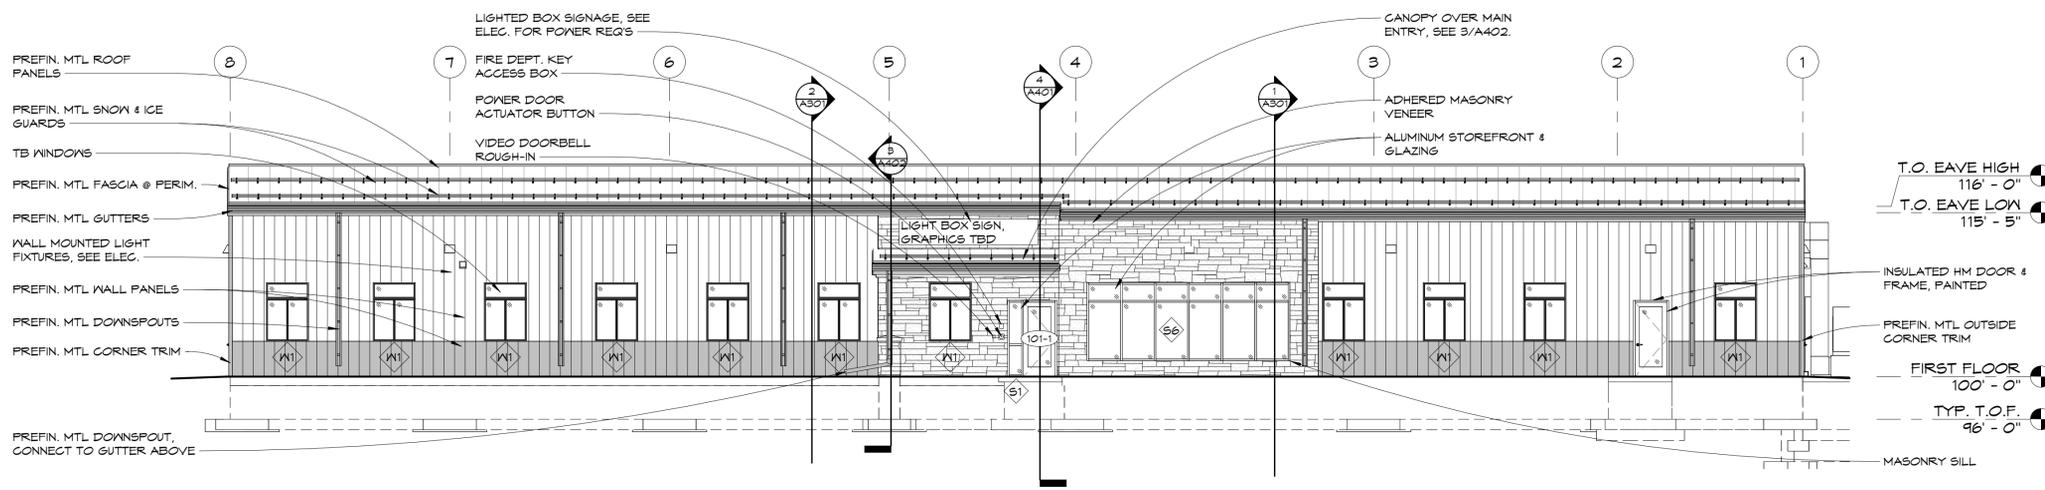


1 NORTHEAST ELEVATION
A201 1/8" = 1'-0"

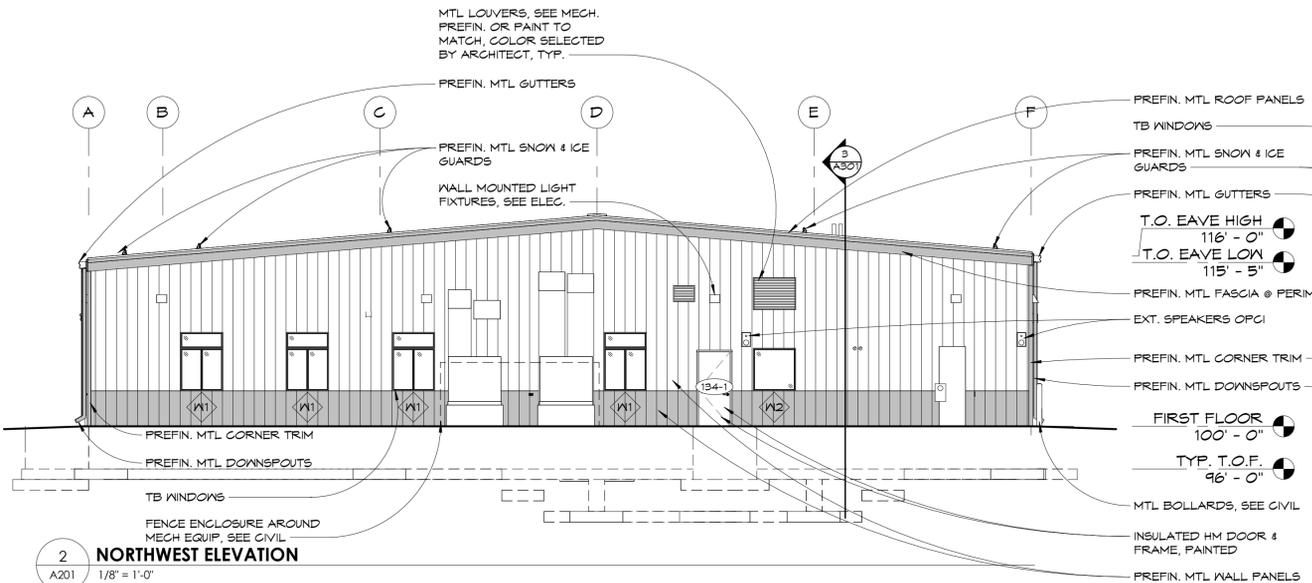

2 NORTHWEST ELEVATION
A201 1/8" = 1'-0"

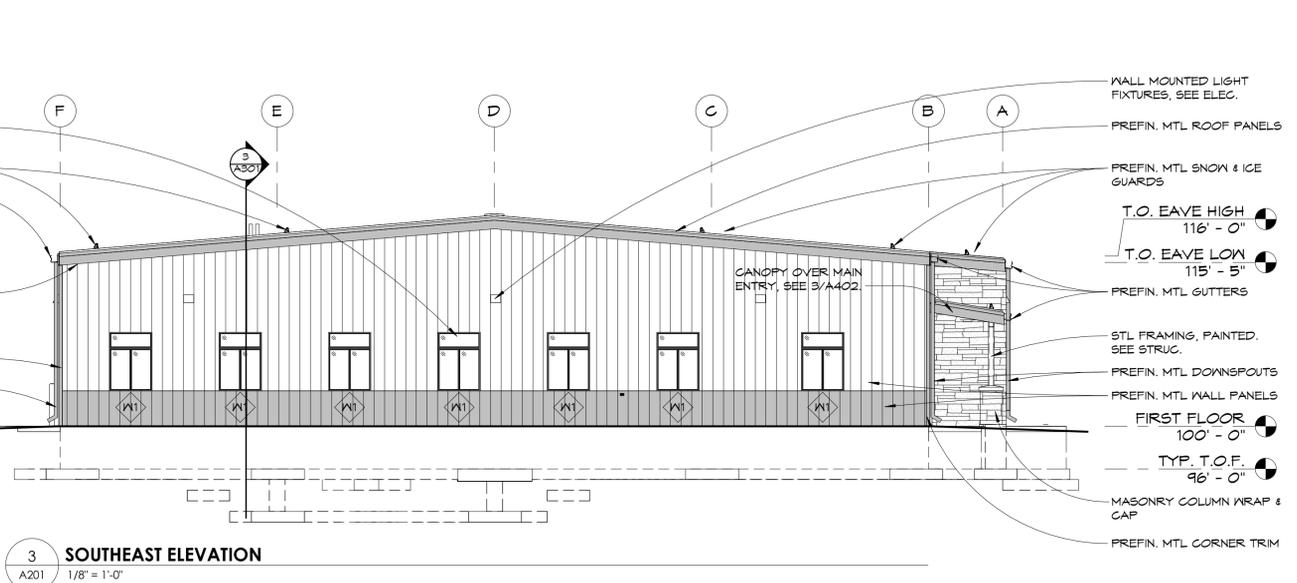

3 SOUTHEAST ELEVATION
A201 1/8" = 1'-0"

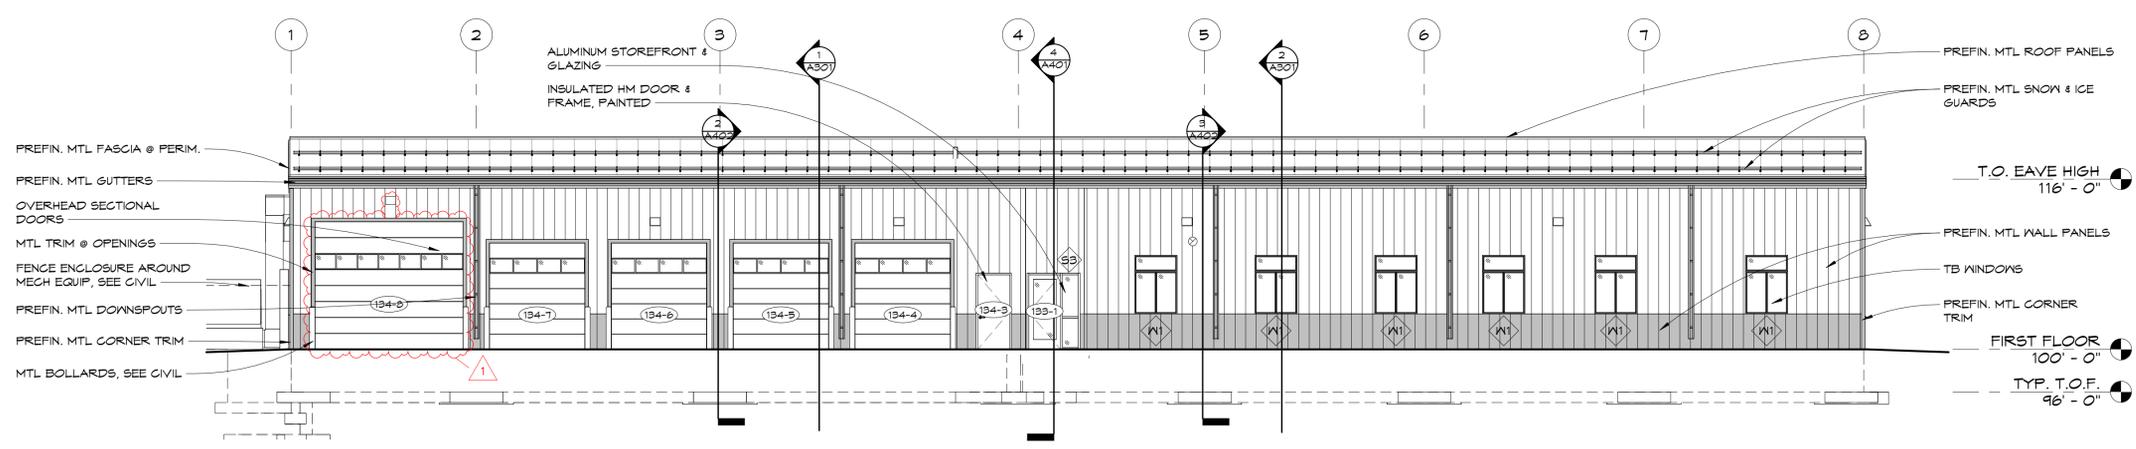

4 SOUTHWEST ELEVATION
A201 1/8" = 1'-0"

ELEVATION KEY

	PREFINISHED METAL PANEL (FINISH #1)
	PREFINISHED METAL PANEL (FINISH #2)
	METAL ROOFING PANELS
	ADHERED STONE VENEER #1
	GLAZING, SEE FRAME TYPES
	CONTROL JOINT
	PANEL JOINT

NORTH CENTRAL STATE OFFICE BUILDING
 ND OFFICE OF MANAGEMENT & BUDGET
 U.S. HIGHWAY 2
 MINOT, ND 58701

DATE: 02/20/2026

CONSTRUCTION DOCUMENTS

REVISION SCHEDULE

#	DATE	REVISION
1	03/04/2026	Addendum #1

PROJECT NO: 25110
DRAWN BY: JTK
CHECKED BY: EMA

DOOR SCHEDULE

ROOM	#	HARDWARE GROUP	FIRE RATING (MIN)	# OF LEAFS	PANEL SPECIFICATIONS					FRAME SPECIFICATIONS							HEAD DETAIL	JAMB DETAIL	REMARKS		
					TYPE	WIDTH	HEIGHT	THICKNESS	MATERIAL	FINISH	GLASS	TYPE	JAMB WIDTH	HEAD HEIGHT	DEPTH	FRAME MATERIAL				FRAME FINISH	FRAME GLASS
VEST.	101-1	7.1	-	1	PNL.FG.AL	3'-0"	7'-0"	1 3/4"	ALUM.	ANODIZED	GL-1	S-1	0'-0"	0'-0"	0'-4 3/4"	ALUM.	ANODIZED	GL-1	4/A610	7/A610	2
VEST.	101-2	6.1	-	1	PNL.FG.AL	3'-0"	7'-0"	1 3/4"	ALUM.	ANODIZED	GL-2	S-2	0'-0"	0'-0"	0'-4 3/4"	ALUM.	ANODIZED	GL-2	5/A610	10/A610	
WCNTF OFFICE	102-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF OFFICE	103-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF OFFICE	104-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF OFFICE	105-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF OFFICE	106-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF OFFICE	107-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF SUPERVISOR	108-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI OFFICE	109-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI OFFICE	110-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI OFFICE	111-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI OFFICE	112-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI OFFICE	113-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
AG DIRECTOR	114-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI SUPERVISOR	115-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI OFFICE	116-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
CYBER OFFICE	117-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
CYBER OFFICE	118-1	2.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
CYBER OFFICE	119-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
CORRIDOR	120-1	4.0	-	1	PNL.F.HM	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
CORRIDOR	120-2	4.0	-	1	PNL.F.HM	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI STORAGE	121-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF STORAGE	123-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
FUTURE BCI OFFICE	124-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
FUTURE BCI OFFICE	125-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
FUTURE WCNTF OFFICE	126-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
TOILET	127-1	2.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
TOILET	128-1	2.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
JANITOR	129-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP ARMORY	130-1	2.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
BCI EVIDENCE	131-1	3.3	20 MIN.	1	PNL.F.WD	3'-6"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
WCNTF EVIDENCE	132-1	3.3	20 MIN.	1	PNL.F.WD	3'-6"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
VEST.	133-1	7.0	-	1	PNL.FG.AL	3'-0"	7'-0"	1 3/4"	ALUM.	ANODIZED	GL-1	S-3	0'-0"	0'-0"	0'-4 3/4"	ALUM.	ANODIZED	GL-1	3/A610	8/A610	
CORRIDOR	133-2	6.0	-	1	PNL.FG.AL	3'-0"	7'-0"	1 3/4"	ALUM.	ANODIZED	GL-2	S-4	0'-0"	0'-0"	0'-4 3/4"	ALUM.	ANODIZED	GL-2	5/A610	10/A610	
GARAGE	134-1	5.0	-	1	PNL.F.HM	3'-0"	7'-0"	1 3/4"	INSUL. HM	PAINT	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	11/A601	6/A601	
GARAGE	134-2	3.1	20 MIN.	1	PNL.F.HM	3'-0"	7'-0"	1 3/4"	INSUL. HM	PAINT	-	HM-1	0'-2"	0'-2"	0'-8 1/8"	HM	PAINT	-	16/A601	17/A601	
GARAGE	134-3	5.0	-	1	PNL.F.HM	3'-0"	7'-0"	1 3/4"	INSUL. HM	PAINT	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	11/A601	6/A601	
GARAGE	134-4	8.0	-	1	OSD-A	9'-0"	10'-0"	SEE SPEC.	STL	PREFIN.	SEE SPEC.	OSD-1	-	-	-	STL	GALVANIZED	SEE SPEC.	5/A601	10/A601	4
GARAGE	134-5	8.0	-	1	OSD-A	9'-0"	10'-0"	SEE SPEC.	STL	PREFIN.	SEE SPEC.	OSD-1	-	-	-	STL	GALVANIZED	SEE SPEC.	5/A601	10/A601	4
GARAGE	134-6	8.0	-	1	OSD-A	9'-0"	10'-0"	SEE SPEC.	STL	PREFIN.	SEE SPEC.	OSD-1	-	-	-	STL	GALVANIZED	SEE SPEC.	5/A601	10/A601	4
GARAGE	134-7	8.0	-	1	OSD-A	9'-0"	10'-0"	SEE SPEC.	STL	PREFIN.	SEE SPEC.	OSD-1	-	-	-	STL	GALVANIZED	SEE SPEC.	5/A601	10/A601	4
GARAGE	134-8	8.0	-	1	OSD-B	14'-0"	12'-0"	SEE SPEC.	STL	PREFIN.	SEE SPEC.	OSD-1	-	-	-	STL	GALVANIZED	SEE SPEC.	5/A601	10/A601	3
TOILET	135-1	2.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-8 1/8"	HM	PAINT	-	16/A601	17/A601	
TOILET	136-1	2.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-8 1/8"	HM	PAINT	-	16/A601	17/A601	
MECH.	137-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
MECH.	138-1	1.0	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP EVIDENCE	139-1	3.2	20 MIN.	1	PNL.F.WD	3'-6"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP ACCIDENT RECON	140-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-7"	HM	PAINT	-	16/A601	17/A601	
HP MOTOR CARRIER	141-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP SERGEANT	142-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP LIEUTENANT	143-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP SERGEANT	144-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
HP PROPERTY	145-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
CORRIDOR	147-1	7.0	-	1	PNL.FG.AL	3'-0"	7'-0"	1 3/4"	ALUM.	ANODIZED	GL-1	S-5	0'-0"	0'-0"	0'-4 3/4"	ALUM.	ANODIZED	-	3/A610	8/A610	
CORRIDOR	147-2	4.0	-	1	PNL.F.HM	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
STORAGE	148-1	1.0	-	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-5 3/4"	HM	PAINT	-	16/A601	17/A601	
SQUAD ROOM	149-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"	0'-7"	HM	PAINT	-	16/A601	17/A601	
TRAINING	150-1	1.1	20 MIN.	1	PNL.F.WD	3'-0"	7'-0"	1 3/4"	SOLID WD	STAIN-1	-	HM-1	0'-2"	0'-2"							



ACKERMAN-ESTVOLD
MINOT | WILLISTON | FARGO | BOISE
www.ackerman-estfold.com

©2025 by Ackerman-Estfold. These drawings, including all design, details, specifications, and information, are the sole copyright of Ackerman-Estfold and are for use on this specific project only. These drawings shall not be used on any other work without written consent and agreement of Ackerman-Estfold.



Prairie Engineering P.C.
Professional Consulting Engineers



NORTH CENTRAL STATE OFFICE BUILDING
ND OFFICE OF MANAGEMENT & BUDGET
U.S. HIGHWAY 2
MINOT, ND 58701

DATE
2/20/2026


CONSTRUCTION DOCUMENTS

REVISION SCHEDULE

#	DATE	REVISION
1	03/04/2026	Addendum 1

PROJECT NO: PE 25048
DRAWN BY: TGR
CHECKED BY: JLM


SHEET
E001
SITE PLAN

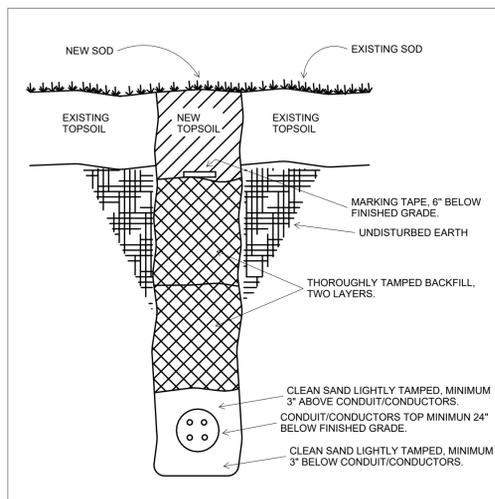


2 UNDERGROUND INSTALLATION
E001 NTS

Keynote Legend

E1	REMOVE EXISTING POWER PEDESTAL FROM THIS APPROXIMATE LOCATION. REFER TO CIVIL FOR EXACT LOCATIONS AS REQUIRED. TURN OVER THE PEDESTAL TO ADJACENT BUILDING OWNER FOR USE AS SPARES.
E2	DISCONNECT EXISTING WEIGHT SHACK POWER FROM THE ADJACENT BUILDING OWNERS' SERVICE. PROVIDE TEMP POWER TO SCALE BUILDING DURING CONSTRUCTION AS REQUIRED. NOTE THAT THE EXISTING FEEDER CONFLICTS WITH THE NEW UTILITY TRANSFORMER LOCATION. RELOCATE OR REFEED AS REQUIRED.
E3	LOCATE EXISTING SCALE CIRCUITRY AND EXTEND THE CONDUIT SYSTEM TO THE NEW BUILDING LOCATION. PROVIDE GROUND CABLE FOR SCALE GROUNDING (MATCH EXISTING WIRE GAUGE AND TYPE). PROVIDE CABLE FOR SCALE COMMUNICATIONS (MATCH EXISTING WIRE GAUGE AND TYPE), AND PROVIDE FLEXIBLE LIQUID TIGHT CONDUIT FOR POWER CIRCUITRY. NEAR THE END OF CONSTRUCTION REMOVE AND RETAIN ALL EXISTING SCALE EQUIPMENT FOR REINSTALL BY EC IN THE NEW BUILDING. INCLUDING BUT NOT LIMITED TO SCALE CONTROLLER, ELECTRONIC SIGN, AND SPEAKERS. SEE KEYNOTE P12 ON DETAIL 1/E200.
E4	SCALE PIT LOCATION.
E5	EXPOSE EXISTING CIRCUITRY AT THE EXISTING POWER PEDESTAL AND PULL IT BACK TO REFEED THE NEW PEDESTALS. PROVIDE NEW CIRCUITRY TO DOWNSTREAM DEVICES AS SHOWN.
E6	PROVIDE MIDWEST ELECTRIC PRODUCTS #U011686 EARTH BURIAL BACK-TO-BACK POWER PEDESTAL. LOCATION COORDINATED WITH CIVIL. VERIFY EXACT LOCATION PRIOR TO INSTALL.
E7	PROVIDE AND INSTALL QUAZITE NO. P61324C0041 COVER, P61324B018 BOX, OR EQUAL BY CARSON FOR THE TYPE BB1 FIXTURE DRIVERS. COORDINATE THE EXACT LOCATION WITH GC.

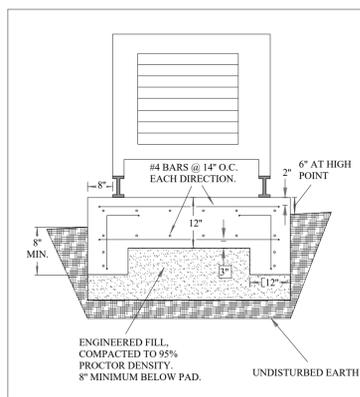

3 GENSET PAD DETAIL
E001 NTS

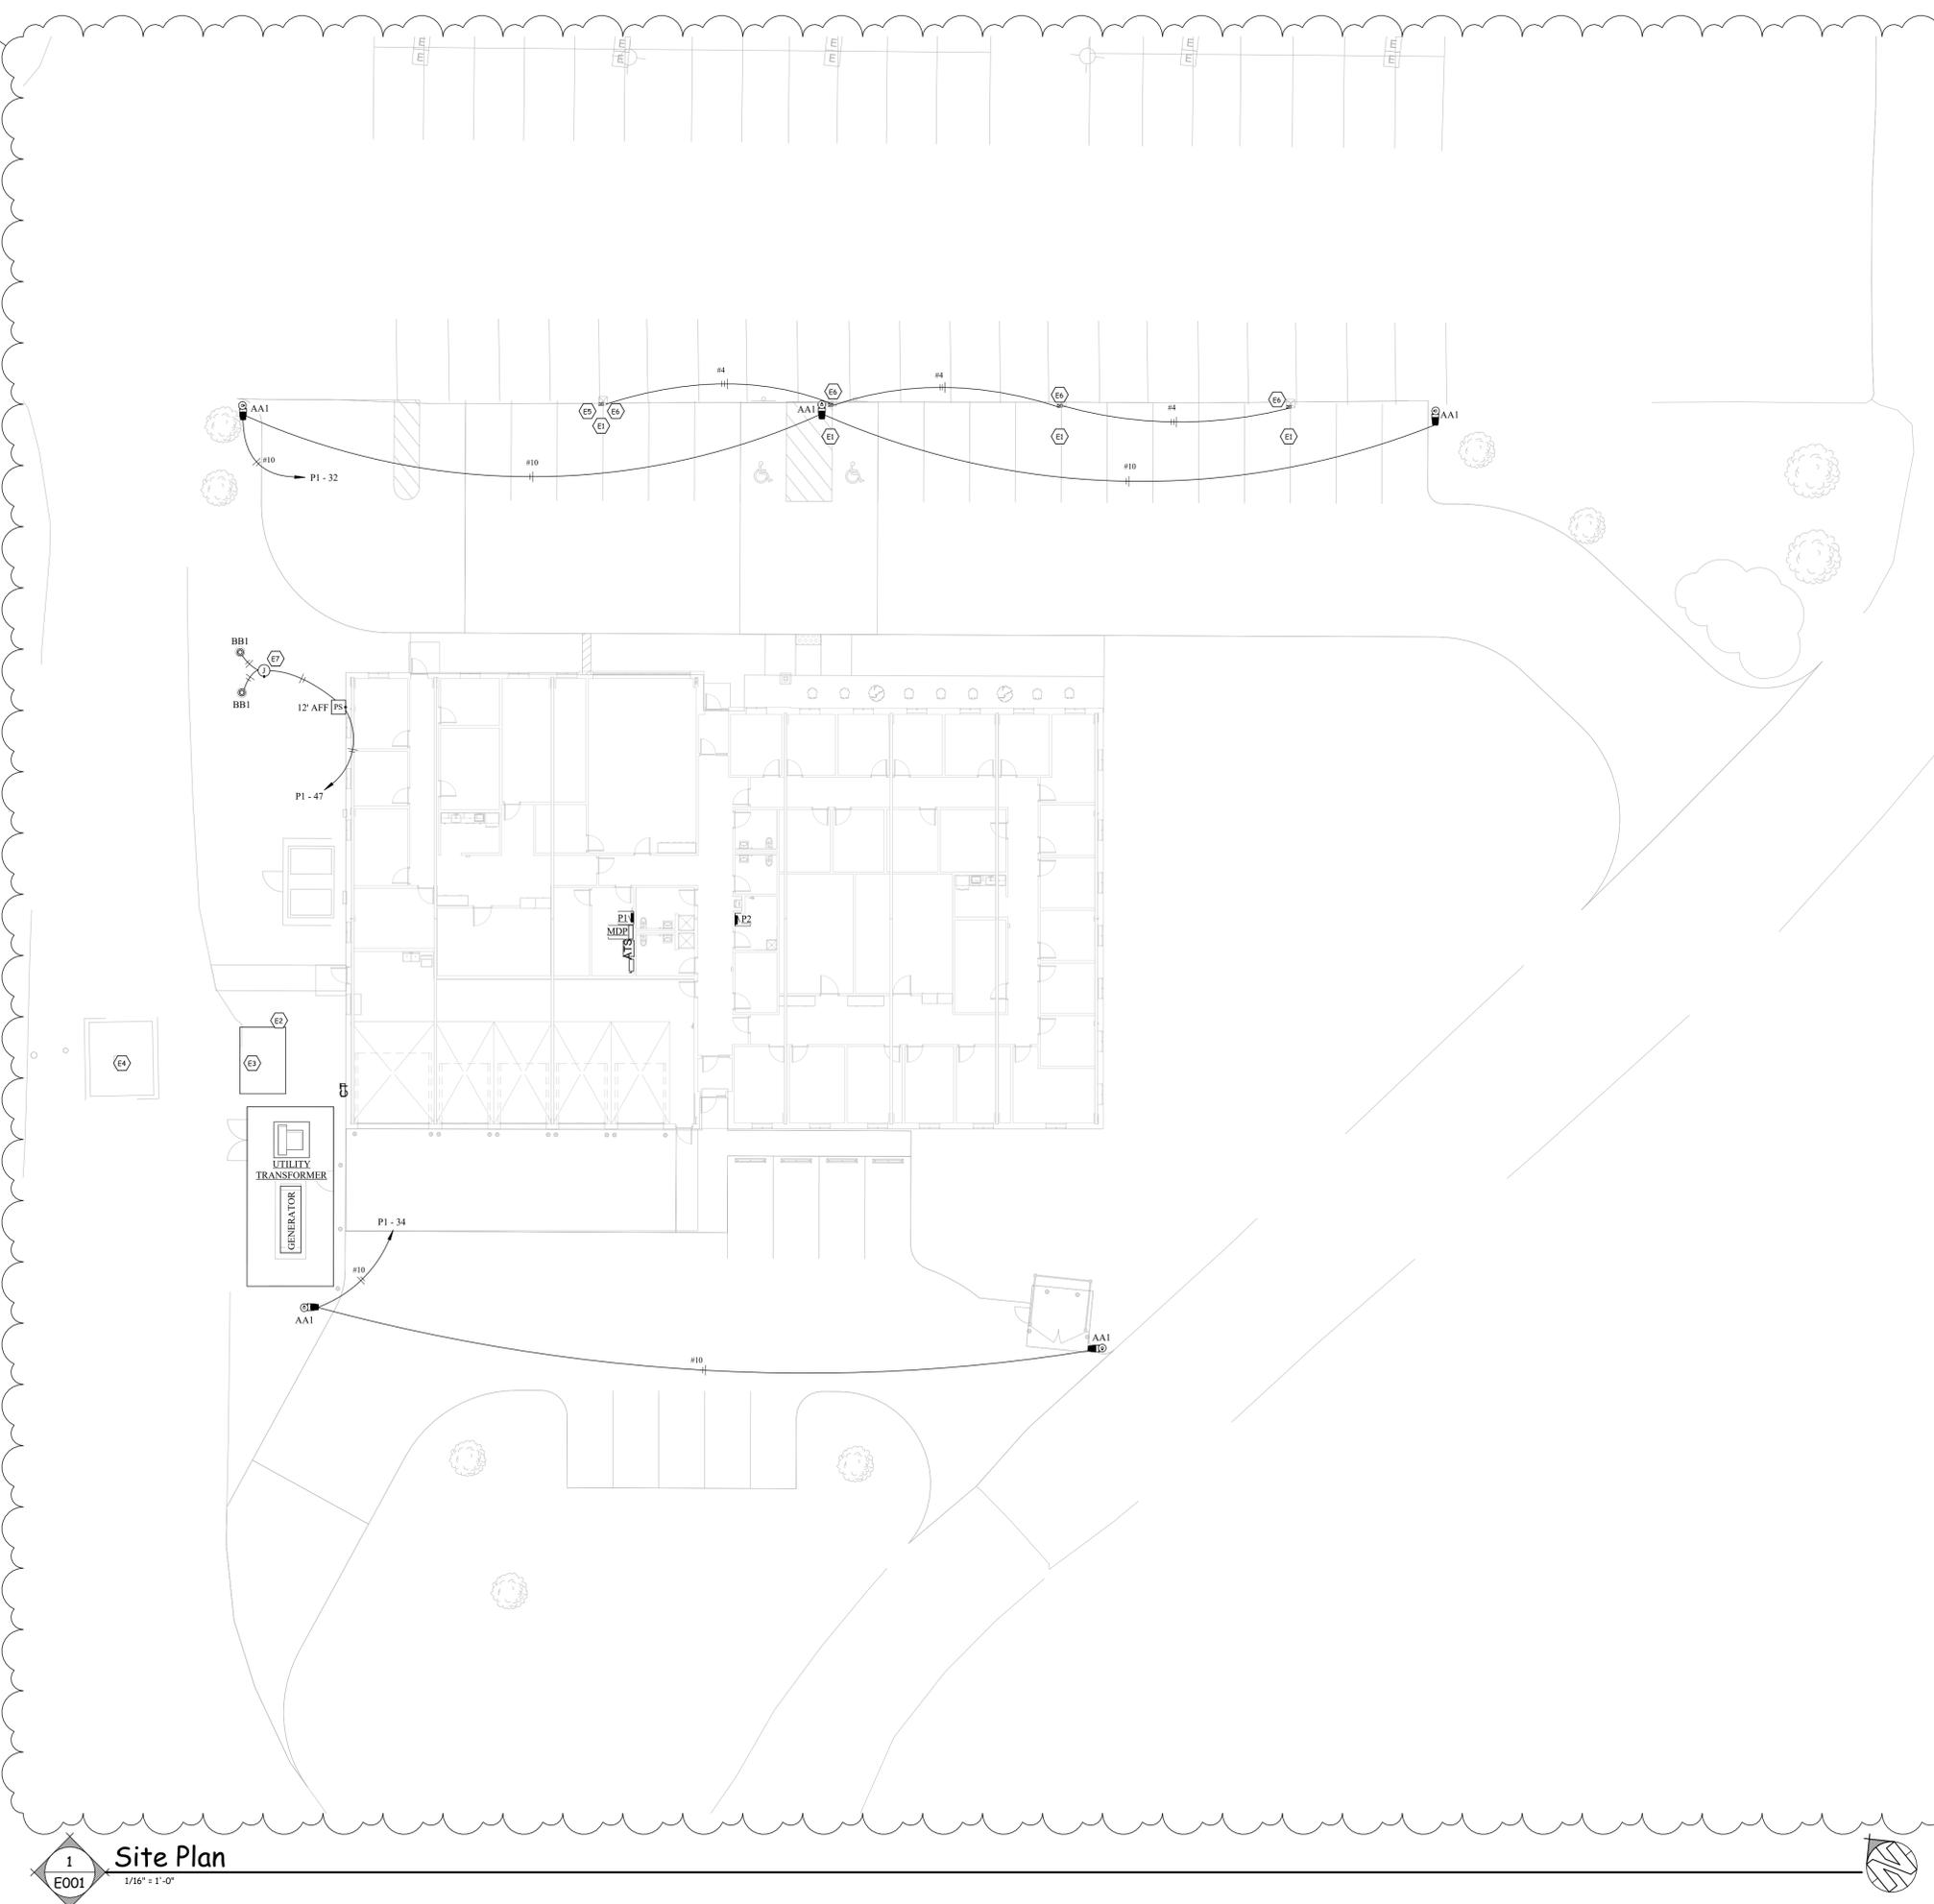

1 Site Plan
E001 1/16" = 1'-0"